



Department of Building & Grounds
Architectural Services Division

City of Baton Rouge
Parish of East Baton Rouge

P.O. Box 1471
Baton Rouge, Louisiana 70821
225 389-4694 Voice
225 389-4704 Fax

ADDENDUM #3

November 4, 2024

TO ALL BIDDERS

**PROJECT: BATON ROUGE POLICE DEPARTMENT TRAINING FACILITY
CITY PARISH PROJECT NO. 21-ASC-CP-1560**

The following revisions shall be incorporated in and take precedence over any conflicting part of the original contract documents.

1. Clarification: Addendum No. 3 is to replace Addendum No. 2 in its entirety.
2. Clarification: A non-mandatory Pre-Bid Conference was held on Tuesday, October 22, 2024 at 2:00 PM at the Baton Rouge Police Department Training Facility future project site, 999 W. Irene Rd., Zachary, Louisiana, 70791. The meeting minutes and sign-in sheet are attached to this addendum.
3. Clarification: Attached are examples of Certified Payroll Reports for reference.
4. Project Manual, Bid Form. Delete Bid Form. Add attached Bid Form.
5. Project Manual. Add attached Unit Price Form.
6. Project Manual, Notice to Contractors, 2nd page, 1st paragraph: delete **“EBE goal of 7% of the contract amount”**, substitute **“EBE goal of 22% of the contract amount”**.
7. Specification Section 01 0000.1.03.B.4, “City Parish Summary of Work; Schedule of Alternates”: Delete “Schedule of Alternates: None”, substitute “Alternate No. 1: Delete prefinished ceiling liner panels at the Simulator Building for the lump sum DEDUCT of:” and “Alternate No. 2 Delete the Classroom Building in its entirety for the lump sum DEDUCT of:”
8. See attached Addendum from BBI Architects, AAC (39 pages.)

The following revisions shall be incorporated in and take precedence over any conflicting part of the original contract documents.

TOTAL PAGES4 (DRAWINGS)
TOTAL PAGES39 (ADDENDUM)
TOTAL PAGES44 (INCLUDING THIS PAGE)

FAILURE TO INDICATE RECEIPT OF THIS ADDENDUM ON BID FORM MAY BE CAUSE FOR THE BID TO BE REJECTED

Rob Gray, AIA, LEED AP BD+C, Interim Chief Architect
Architectural Services Division
1100 Laurel Street, Rm. 227
Baton Rouge, LA 70802

Certified Payroll Transcript

PR #1

Period: 1/30/2023 - 2/5/2023

Job: PSC H2 BUILDING RENOVATION FOR VETERAN'S AFFAIRS

Contract: 21-ASC-CP-1558

-----Hours-----												***** Weekly Totals ***** (Week Ending 2/5/23)		
Employee	Sun	Mon	Tue	Wed	Thu	Fri	Sat	Total	Rate	Project Amounts	Total Gross	Deductions	Net Pay	
M/EX: M/1	0.00	0.00	0.00	0.00	0.00	8.00	0.00	8.00	22.000	176.00	Federal Withholding	17.00		
Race/Sex: B/M	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.350	2.80	Social Security	43.65		
Non Union										0.00	Medicare	10.21		
Operator										0.00	Additional Medicare T			
EEO:										178.80	Louisiana Withholding	19.07		
Check #: 0209231											Other			
											704.00	89.93	614.07	
M/EX: M/0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	29.000	0.00	Federal Withholding	67.00		
Race/Sex: W/M										0.00	Social Security	71.92		
Non Union										0.00	Medicare	16.82		
Pipefitter										0.00	Additional Medicare T			
EEO:										0.00	Louisiana Withholding	38.12		
Check #: 0209231											1,210.00	193.86	1,016.14	
M/EX: S/0	0.00	0.00	0.00	0.00	0.00	8.00	0.00	8.00	20.000	160.00	Federal Withholding	21.00		
Race/Sex: B/M	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	2.840	22.72	Social Security	29.76		
Non Union										0.00	Medicare	6.96		
Laborer										0.00	Additional Medicare T			
EEO:										182.72	Louisiana Withholding	11.23		
Check #: 0209231											Other	159.38		
											480.00	228.33	251.67	
-----Hours-----												***** Weekly Totals ***** (Week Ending 2/5/23)		
Job Totals (Hours)	Sun	Mon	Tue	Wed	Thu	Fri	Sat	Total	Rate	Project Amounts	Total Gross	Deductions	Net Pay	
Regular Time	0.00	0.00	0.00	0.00	0.00	16.00	0.00	16.00		336.00	Federal Withholding	105.00		
Cash Fringe	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		25.52	Social Security	145.33		
										0.00	Medicare	33.99		
										0.00	Additional Medicare T			
										361.52	Louisiana Withholding	68.42		
											Other	159.38		
											2,394.00	512.12	1,881.88	

LOUISIANA UNIFORM PUBLIC WORK BID FORM

TO: City of Baton Rouge
Parish of East Baton Rouge
Purchasing Division Room 826
City Hall 222 St Louis St
Baton Rouge, LA 70802

BID FOR: Baton Rouge Police Department Training Facility
999 West Irene Rd.
Zachary, LA 70791

City-Parish Project No. 21-ASC-CP-1560

The undersigned bidder hereby declares and represents that she/he; a) has carefully examined and understands the Bidding Documents, b) has not received, relied on, or based his bid on any verbal instructions contrary to the Bidding Documents or any addenda, c) has personally inspected and is familiar with the project site, and hereby proposes to provide all labor, materials, tools, appliances and facilities as required to perform, in a workmanlike manner, all work and services for the construction and completion of the referenced project, all in strict accordance with the Bidding Documents prepared by: **Department of Buildings & Grounds, Architectural Services Division** and dated: **October 1, 2024**.

Bidders must acknowledge all addenda. The Bidder acknowledges receipt of the following **ADDENDA:** *(Enter the number the Designer has assigned to each of the addenda that the Bidder is acknowledging)* _____ .

TOTAL BASE BID: For all work required by the Bidding Documents (including any and all unit prices designated "Base Bid" * but not alternates) the sum of:

_____ Dollars (\$_____)

ALTERNATES: For any and all work required by the Bidding Documents for Alternates including any and all unit prices designated as alternates in the unit price description.

Alternate No. 1: *Alternate No. 1: Delete prefinished ceiling liner panels at the Simulator Building for the lump sum DEDUCT of*

_____ Dollars (\$_____)

Alternate No. 2: *Alternate No. 2 Delete the Classroom Building in its entirety for the lump sum DEDUCT of*

_____ Dollars (\$_____)

Alternate No. 3: *N/A*

_____ Dollars (\$_____)

NAME OF BIDDER: _____

ADDRESS OF BIDDER: _____

LOUISIANA CONTRACTOR'S LICENSE NUMBER: _____

NAME OF AUTHORIZED SIGNATORY OF BIDDER: _____

TITLE OF AUTHORIZED SIGNATORY OF BIDDER: _____

SIGNATURE OF AUTHORIZED SIGNATORY OF BIDDER **: _____

DATE: _____

THE FOLLOWING ITEMS ARE TO BE INCLUDED WITH THE SUBMISSION OF THIS LOUISIANA UNIFORM PUBLIC WORK BID FORM:

* The Unit Price Form shall be used if the contract includes unit prices. Otherwise it is not required and need not be included with the form. The number of unit prices that may be included is not limited and additional sheets may be included if needed.

** **A CORPORATE RESOLUTION OR WRITTEN EVIDENCE** of the authority of the person signing the bid for the public work as prescribed by LA R.S. 38:2212(B)(5).

BID SECURITY in the form of a bid bond, certified check or cashier's check as prescribed by LA RS 38:2218(A) is attached to and made a part of this bid.

LOUISIANA UNIFORM PUBLIC WORK BID FORM

UNIT PRICE FORM

TO: City of Baton Rouge
 Parish of East Baton Rouge
 Purchasing Division, City Hall
 222 Saint Louis St., 8th floor, Room 826
 Baton Rouge, Louisiana 70802

BID FOR:
Baton Rouge Police Department Training Facility
999 West Irene Road
Zachary, LA 70791

UNIT PRICES: This form shall be used for any and all work required by the Bidding Documents and described as unit prices. Amounts shall be stated in figures and only in figures.

DESCRIPTION:	<input checked="" type="checkbox"/> Base Bid or <input type="checkbox"/> Alt.# ____ Limestone and site preparation associated with installation of limestone.			
REF. NO.	QUANTITY:	UNIT OF MEASURE:	UNIT PRICE	UNIT PRICE EXTENSION <i>(Quantity times Unit Price)</i>
Unit Price #1	1000	Square Feet		

DESCRIPTION:	<input type="checkbox"/> Base Bid or <input type="checkbox"/> Alt.# ____ Not applicable.			
REF. NO.	QUANTITY:	UNIT OF MEASURE:	UNIT PRICE	UNIT PRICE EXTENSION <i>(Quantity times Unit Price)</i>
Not applicable	Not applicable	Not applicable	Not applicable	Not applicable

DESCRIPTION:	<input type="checkbox"/> Base Bid or <input type="checkbox"/> Alt.# ____ Not applicable.			
REF. NO.	QUANTITY:	UNIT OF MEASURE:	UNIT PRICE	UNIT PRICE EXTENSION <i>(Quantity times Unit Price)</i>
Not applicable	Not applicable	Not applicable	Not applicable	Not applicable

DESCRIPTION:	<input type="checkbox"/> Base Bid or <input type="checkbox"/> Alt.# ____ Not applicable.			
REF. NO.	QUANTITY:	UNIT OF MEASURE:	UNIT PRICE	UNIT PRICE EXTENSION <i>(Quantity times Unit Price)</i>
Not applicable	Not applicable	Not applicable	Not applicable	Not applicable

DESCRIPTION:	<input type="checkbox"/> Base Bid or <input type="checkbox"/> Alt.# ____ Not applicable.			
REF. NO.	QUANTITY:	UNIT OF MEASURE:	UNIT PRICE	UNIT PRICE EXTENSION <i>(Quantity times Unit Price)</i>
Not applicable	Not applicable	Not applicable	Not applicable	Not applicable

DESCRIPTION:	<input type="checkbox"/> Base Bid or <input type="checkbox"/> Alt.# ____ Not applicable.			
REF. NO.	QUANTITY:	UNIT OF MEASURE:	UNIT PRICE	UNIT PRICE EXTENSION <i>(Quantity times Unit Price)</i>
Not applicable	Not applicable	Not applicable	Not applicable	Not applicable

All quantities are estimated. The contractor will be paid based upon actual quantities as verified by the Owner.

ADDENDUM NUMBER THREE (3)

Date: November 1, 2024

Project: **Baton Rouge Police Department
Training Facility**
999 West Irene Road
Zachary, Louisiana

Architect: BBI Architects, AAC
1111 S. Foster, Suite D
Baton Rouge, LA 70806

THE FOLLOWING ADDITIONS, CLARIFICATIONS, DELETIONS, AND/OR CORRECTIONS TO THE ORIGINAL CONTRACT DOCUMENTS ARE HEREBY SPECIFICALLY MADE A PART OF THOSE ORIGINAL CONTRACT DOCUMENTS WITH THE SAME FORCE AND EFFECT AS THOUGH ORIGINALLY SET FORTH IN FULL. CHANGES TO THE DRAWINGS AND SPECIFICATIONS SHALL BE LISTED AND OTHERWISE EXPLAINED BY THIS ADDENDUM. ANY CONTRADICTIONS IN THESE DOCUMENTS SHALL BE IMMEDIATELY POINTED OUT TO THE ARCHITECT SO THAT A DECISION CAN BE RENDERED.

GENERAL NOTES / CLARIFICATIONS:

1. Addendum no 3 replaces Addendum no 2.
2. A Pre-Bid Meeting minutes and sign-in sheet of attendees is attached to this addendum.
3. Impact fees, permitting fees, tap fees or any other fees or charges required to permit or construct the project shall be paid for by the General Contractor as part of the project.
4. Alternate Bids: Add the following Alternate Bids:
 - a. Alternate Bid No 1: Deduct prefinished ceiling liner panels at Simulator Building
 - b. Alternate Bid No 2: Deduct the Classroom Building in its entirety
5. Add Unit Pricing for limestone and site preparation associated with installing the limestone.
6. All refrigerant lines, electrical conduits, plumbing lines, etc. shall be run inside wall cavities and not exposed to the exterior.

GEOTECHNICAL REPORT

1. The Geotechnical Report for this project is included in this addendum and is hereby part of the Construction Documents.

CIVIL

Sheet C1.1

1. 1C1.1, Site Plan:

ADDENDUM NUMBER THREE (3)

- a. Add a 3/4" underground water line from Classroom Building to Simulator Building.
 - b. Provide shut off valve with drain outside of the Classroom building
 - c. Install hose bibbs on interior of Simulator Building adjacent to door 3 and door 7
 - d. Delete all limestone and site preparation associated with the limestone except for 1000sf to be placed around the perimeter of the Simulator Building (addition limestone may be incorporated on a Unit Price basis depending on funding).
 - e. Top of limestone shall be 1 – 2" above existing grade
2. 4C1.1, Site Preparation Notes:
- a. Note 4: Clarification, Delete note 4 in its entirety and replace with the following.
 - 4.1 Remove uppermost 12" of topsoil under and 5' beyond the perimeter of the building.
 - 4.2 At footings and grade beams remove 12" below the deepest footing elevation, or as need to remove loose or unsuitable soils that cannot be improved by compaction.
 - b. Add Note 10: Excavated soil shall remain on-site. Spoils shall be stacked neatly and dressed a location designated at the time of the preconstruction meeting.
 - c. Add Note 11: Provide Unit Costs pricing for:
 1. Limestone and the site preparation associated with installing the limestone in accordance with 4C1.1, Site Preparation Notes, Note 5
 2. And limestone as specified in 2C1.1, Legend
 3. 1 Unit = a 10 square foot section of limestone and associated site preparation.
4. 6C1.1, Sanitary Sewer Treatment Unit:
- a. Note 2.A: Delete "1,197 Gallons" and substitute "750 Gallons"
 - b. Note 8: Delete "63 Watts" and substitute "157 Watts" (verify)
 - c. Add 750-gallon chlorine contact disinfectant chamber with effluent pump.
 - i. Provide electrical connections as required
 - b. Change spray head spacing to 40' o.c.
 - c. Provide shop drawings of the complete system

ARCHITECTURAL

Sheet A1.2

1. 1A2.1, Classroom Ceiling Plan:
 - a. Delete the 2 high volume low speed ceiling fans ceiling fans shown. Electrical connections to remain.

Sheet A2.1

1. 1A2.1, Simulator Building - Floor Plan:
 - a. Delete Door 1 shown and replace with breaching door:
Ram-Pry Door assembly with integrated Burglar Bar Breaching Door (one assembly)
BTI Doors
<https://breachingtechnologies.com/law-enforcement/admin@breachingtechnologies.com>
(210) 954-4817

Provide MC8x 8.5 framing at jambs and head from wall to column (or wall)

ADDENDUM NUMBER THREE (3)

Through bolt jamb of door to steel frame
Coordinate rough opening with door manufacturer

- b. Delete Door 9 and replace with forced entry breaching door:
Catalyst Forced Entry Tactical Breach door
Forced Entry Inc
<https://www.forcibleentry.com/catalyst-force-entry-door-tactical-breacher>
(916) 337 5705

Provide MC8x 8.5 framing at jambs and head from wall to wall
Through bolt jamb of door to steel frame
Coordinate rough opening with door manufacturer

2. 3A2.1, Project Notes:
 - a. Note 4: Delete "... FULL SET..." and replace with "...6...".
 - b. Note 5:
 - i. Delete "(15) 2'-8"x 6'-8" and replace with "(5) 2'-8"x 6'-8"
 - ii. Delete "(8) 2'-6"x 6'-8" and replace with "(3) 2'-6"x 6'-8"
 - c. Delete "(5) 2'-4"x 6'-8" and replace with "(2) 2'-4"x 6'-8"
3. 3A2.1, Project Notes:
 - a. Note 3: Delete note in its entirety and replace with "PROVIDE ½" OSB TYPICALLY", SMOOTH SIDE OUT.
 - b. Note 4: Delete note in its entirety
 - c. Note 5: Delete note in its entirety
4. 4A2.1, Finish Notes:
 - a. Add Note 13.:
13. Seal concrete floor with clear, silane siloxane coating

Sheet A2.3

1. 1A2.1, Classroom Ceiling Plan:
 - a. Delete 3 high volume low speed ceiling fans. Electrical connections to remain.
 - b. Prefinished Metal

Sheet A2.6

1. 2A2.6, Elevation - North:
 - a. Deleted:
 - i. Acrylic letter sign
 - ii. BRPD Patch logo sign
 - iii. SWAT patch logo sign

Sheet A4.1

1. Delete existing sheet A4.1 and replace with new sheet A4.1 included in this addendum.
Changes include:
 - a. At interior walls, changed metal studs to 2x 4 wood
 - b. At interior walls, deleted metal wall cap in favor of painted 1x 6

ADDENDUM NUMBER THREE (3)

- c. All interior walls changed gypsum board to OSB

STRUCTURAL

Sheet S1.1

- 1. 1S1.1, Classroom – Foundation Plan:
 - a. Delete the Concrete Slab notes in its entirety. Refer to 2S1.1, Foundation Notes.

Sheet S2.2

- 1. 1S2.2, Simulator Building – Foundation Plan:
 - a. Delete “Concrete Slab” notes in its entirety. Refer to 2S1.1, Foundation Notes.
 - b. Add drawing 5S2.2 – Foundation Schedule

5 FOUNDATION SCHEDULE			
MARK	FOOTING SIZE	FOOTING THICKNESS	REINFORCEMENT
F1*	2'-6" x 2'-6"	12"	3 – #5 BARS EACH WAY AT BOTTOM
F2*	3'-0" x 3'-0"	12"	4 – #5 BARS EACH WAY AT BOTTOM
F3*	4'-0" x 4'-0"	16"	5 – #5 BARS EACH WAY AT BOTTOM
F4*	4'-6" x 4'-6"	16"	6 – #5 BARS EACH WAY AT BOTTOM
F5*	5'-6" x 5'-6"	18"	7 – #5 BARS EACH WAY AT BOTTOM 4 – #4 SHORT BARS EACH WAY AT TOP
F6*	6'-0" x 6'-0"	20"	8 – #5 BARS EACH WAY AT BOTTOM 4 – #4 SHORT BARS EACH WAY AT TOP

MECHANICAL

Sheet M1.1

- 1. 1M1.1, Plumbing Floor Plan:
 - a. Extend an underground 3/4" water line from Classroom Building to Simulator Building.
 - b. Provide shut off valve with drain outside the Classroom building.
 - c. Install hose bibbs on interior of Simulator Building adjacent to door 3 and door 7
 - d. Plumbing contractor shall eliminate the tank type water heater shown on M1.1, including the associated Floodsafe Kit and recirculating pump and piping. In lieu of tank type, the following water heaters shall be used.
 - i. Each LAV lavatory shall be furnished with EEMAX SPEX4208T EE, 4.1kw, 208-1-60 electrical service.
 - ii. Mop sink MS shall be furnished with EEMAX SPEX8208T EE, 8.3kw, 208-1-60 electrical service

ADDENDUM NUMBER THREE (3)

2. Plumbing Fixture Schedule:

- a. Mop sink MS shall be revised to a Fiat FL-1 floor mounted sink on legs. Furnish with faucet (1.5 gpm aerator), drain assembly, ptrap and 1/4 turn stops. Modify piping connections to accommodate new sink configuration.

Sheet M2.1

1. 1M2.1, HVAC Floor Plan:

- a. Shift Heat Pump HP-1 plan south to avoid conflict with electrical panels. Refer to Sheet E3.0 for location of panels. L-2 louvers shall be shifted accordingly with HP-1 such that they do not fall directly above the discharge of HP-1.
- b. All refrigerant lines, electrical conduits, plumbing lines, etc shall be run inside wall cavities and not exposed to the exterior.

ELECTRICAL

Sheet E0.0

1. Delete existing sheet E0.0 and replace with new sheet E0.0 included in this addendum

Sheet E0.1

1. Delete existing sheet E0.1 and replace with new sheet E0.1 included in this addendum

Sheet E3.0

1. Delete existing sheet E3.0 and replace with new sheet E3.0 included in this addendum
2. Clarification: If Alternate Bid No 2 is accepted the electrical service will be relocated to the Simulator Building on the stair wall. No changes will be made to the service capacity.

SPECIFICATIONS

Section 13 3419 – Metal Building Systems

1. Paragraph 2.4, Metal Roof Panels

- a. Materials specified in paragraph 2.5.A shall be used on the Classroom building.
- b. Change paragraph 2.5.B to paragraph 2.5.C
- c. Add paragraph 2.5.B as follows (for use on the Simulator Building ONLY):
 - i. PBR (Purlin Bearing Rib) roof panels:
 1. Coverage width: 36 in
 2. Length: Continuous
 3. Panel attachment: Exposed fastening system
 4. Gauge: 24
 5. Finishes: Smooth
 6. Coatings: Exterior Finish: Fluoropolymer two-coat system selected from manufacturer's standard colors
 7. Rib spacing: 12 in on center
 8. Rib height: 1-1/4 in

ADDENDUM NUMBER THREE (3)

9. Minimum slope: 1/2:12
10. Flame-spread index: 25 or less (Class A)
11. Tensile strength: Minimum of 80,000 ksi

2. Paragraph 2.5, Metal Wall Panels

- a. Delete paragraph 2.5.C in its entirety and substitute the following:
 - i. Subject to compliance with requirements provide PBR (Purlin Bearing Rib) wall panels:
 1. Coverage width: 36 in
 2. Length: Continuous
 3. Panel attachment: Exposed fastening system
 4. Gauge: 24
 5. Finishes: Smooth
 6. Coatings: Exterior Finish: Fluoropolymer two-coat system selected from manufacturer's standard colors
 7. Rib spacing: 12 in on center
 8. Rib height: 1-1/4 in
 9. Flame-spread index: 25 or less (Class A)

PRIOR APPROVALS

ARCHITECTURAL PRIOR APPROVALS:

Section 13 3419 – Metal Building Systems
Mueller Metal Buildings

End of Addendum

BRPD Training Facility

999 West Irene Road
Zachary, LA

Pre-Bid Meeting Minutes

1. Sign sheet was distributed
2. Rob Gray opened the meeting at 2pm on Tuesday, October 22, 2024 at the future site of the new buildings and presented the following:
 - a. Project: Baton Rouge Police Department Training Facility
 - b. Bid Opening is 2pm, Thursday, November 7th at Purchasing office at City Hall downtown on St. Louis Street
 - c. Bids can be submitted in person prior to the bid opening or on-line through Central Auction House
 - d. Bid Documents are available thru Central Bidding (centralauctionhouse.com)
 - e. Plans can be distributed individually however you will not be on the Central Auction House notification list.
 - f. Contract Completion Time: 180 consecutive days
 - g. Liquidated Damages: \$605 per day
 - h. Bid Bond: 5% of the bid
 - i. Project consist of:
 - i. 6,000sf Simulator building
 - ii. 2,400sf Classroom building
 - j. Bid Submission:
 - i. Hand-deliver to purchasing or submit via Central Auction House
 - ii. Bid documents available for download via Central Bidding
 - iii. Carefully follow the instructions on bidding included in the Project Manual.
 - k. Addenda(s):
 - i. Contractors are responsible for checking the bidding houses website for the addendums. They will not be sent to everyone directly.
 - ii. Addendum No 1 will be loaded tomorrow
 1. This Addenda will replace the entire set of drawings.
 - iii. There will be a second Addendum loaded 72 hours prior to bidding, 2pm November 4th

- I. Bidders requiring clarification or interpretation of the Construction Documents are to make a written request to the Architect by 2pm October 31st.
 - m. Prior Approvals are to made via written request to the Architect by 2pm October 31st
 - i. Contractors were cautioned to review the specifications for specifics on how and what to submit for prior approval.
 - n. No substitutions will be allowed after bidding
 - o. In order to bid Contractors must be licensed in State of Louisiana for Building Construction
 - p. Statutory Forms are to be submitted with the bid.
3. Brent Bueche reviewed the Scope of Work:
- a. Simulator Building Purpose: Training facility for various police and SWAT scenarios.
 - i. Features:
 1. Multiple rooms and doors for different configurations
 2. Catwalk for observation
 3. Simulation rounds (not live fire)
 4. Open air ventilation with large fans (no air conditioning)
 5. Steel catwalk requiring detailed inspection by steel contractors
 - b. Classroom Building
 - i. Features:
 1. One large classroom
 2. Two restrooms
 3. Storage room
 4. Porch with large fans
 - c. Utilities:
 - i. Power from a nearby utility pole
 - ii. Water from the adjacent road
 - iii. Sewer treatment plant will be installation as part of the work
 - iv. Limestone driveway and parking lot
4. Unique Aspects of the project;
- a. Complete sets of replacement windows and doors are to be included to be stored on-site.
 - b. Hallway Plugs: Blanks to create dead-end corridors for simulations.
 - c. Site Conditions: Poor soil quality will require significant excavation and backfilling.
5. Meeting was open to questions:
- a. Project is not tax exempt
 - b. Prevailing wages under Davis-Bacon are not applicable.
6. Certified Payroll will be required for federal audit compliance under the ARPA program. Submission of weekly payroll reports from general contractors and subs, even if showing zero dollars when work is paused
7. Excavation spoils may be stored on-site. Information will be provided in the next addendum

Meeting Adjourned

Date: October 22, 2024





Project: BRPD Training Facility

Project No: 21-ASC-CP-1560

Bid Date: November 7, 2024

PRE-BID CONFERENCE SIGN-IN SHEET

PLEASE SIGN IN AND WRITE YOUR PHONE NUMBER AND FAX NUMBER

(Print) Name & Email	Phone Number	Fax Number	Company Name & License#	Signature
Name: <u>Dwayne BLANC</u> Email: <u>Bid@melinconstruct.com</u>	<u>225-435-3006</u>		<u>42839</u>	
Name: <u>BRANDON LABIT</u> Email: <u>BRANDON@PREMIERCONSTRUCTIONLLC.COM</u>	<u>225-584-0769</u>		<u>P.C.R.</u>	
Name: <u>FRANK ALVARCZ</u> Email: <u>FRANK@Premierconstructionbr.com</u>	<u>225-978-3665</u>		<u>64883</u> <u>Premier Construction Grande</u>	<u>Frank Alvarc</u>
Name: <u>Ricky Roth</u> Email: <u>Ricky@StricklinandPartner.com</u>	<u>601-807-6057</u>		<u>72413</u>	
Name: <u>Michael Stricklin</u> Email: <u>MStricklin@Stricklinandpartner.com</u>	<u>318-4214860</u>		<u>72413</u> <u>Stricklinandpartner Construction</u>	

Date: October 22, 2024

Project: BRPD Training Facility

Project No: 21-ASC-CP-1560

Bid Date: November 7, 2024

PRE-BID CONFERENCE SIGN-IN SHEET

PLEASE SIGN IN AND WRITE YOUR PHONE NUMBER AND FAX NUMBER

(Print) Name & Email	Phone Number	Fax Number	Company Name & License#	Signature
Name: <u>Cindy Crumbolt</u> Email: <u>Cindy@jreedconstructors.net</u>	<u>225-201-8826</u>		<u>37085</u>	<u>Cindy Crumbolt</u>
Name: <u>GREG FLITTER</u> Email: <u>BEDS@JWGRAND.COM</u>	<u>225-767-3724</u>		<u>9569 / JW GRAND</u>	<u>Greg Flitter</u>
Name: <u>Eric Turner</u> Email: <u>ETurner@vpsenterprise.com</u>	<u>205-936-9431</u>		<u>61043</u>	<u>Eric Turner</u>
Name: <u>SCOTT DEUMITE</u> Email: <u>rgoudeau@deumite.com</u>	<u>225-769-2943</u>		<u>43152</u>	<u>Scott Deumite</u>
Name: <u>BEN FONTANA</u> Email: <u>apittman@capconla.com</u>	<u>225-751-0386</u>		<u>44097</u>	<u>Ben Fontana</u>

Date: October 22, 2024






Project: BRPD Training Facility

Project No: 21-ASC-CP-1560

Bid Date: November 7, 2024

PRE-BID CONFERENCE SIGN-IN SHEET

PLEASE SIGN IN AND WRITE YOUR PHONE NUMBER AND FAX NUMBER

(Print) Nam & Email	Phone Number	Fax Number	Company Name & License#	Signature
Name: <u>Linwood Williams</u> Email: <u>Linwood@SMRcompanies</u>	<u>(225) 454 8903</u>		<u>SMR civil contractors</u> <u>69088</u>	
Name: <u>KENNY LANG</u> Email: <u>KML@COX.NET</u>	<u>225.413.0531</u>		<u>PRODIGY GROUP</u>	
Name: <u>Chad Bossem</u> Email: <u>Chad@sandear.com</u>	<u>225-315-1398</u>		<u>S+E Heating & Air</u>	
Name: <u>Carlos Vargas</u> Email: <u>carlosvargas5398@gmail</u>	<u>225-413-3786</u>		<u>Vargas Raining LLC</u>	
Name: <u>Manuel Miranda</u> Email: <u>Constructionquality2a@gmail.com</u>	<u>225-620-5362</u>		<u>Construction Quality LLC</u>	

Date: October 22, 2024




Project: BRPD Training Facility

Project No: 21-ASC-CP-1560

Bid Date: November 7, 2024

PRE-BID CONFERENCE SIGN-IN SHEET

PLEASE SIGN IN AND WRITE YOUR PHONE NUMBER AND FAX NUMBER

(Print) Name & Email	Phone Number	Fax Number	Company Name & License#	Signature
Name: <u>DAVE DAVIS</u> Email: <u>ddavis91@mc.com</u>	<u>225.505.6030</u>		<u>Apex Architecture/Floors</u>	
Name: <u>ROBERT THORNTON</u> Email: <u>NWILLIAMS@legacyband.com</u>	<u>504-421-7293</u>		<u>LEGACY RESTORATION and Refinishing</u>	
Name: <u>CHET MEDLOCK</u> Email: <u>Chetm1823@att100.com</u>	<u>(225) 803-9372</u>		<u>CM METALS</u>	
Name:				
Email:				
Name:				
Email:				

Environmental • Construction Materials Testing • Geotechnical • Subsurface Investigations



Environmental • Construction Materials Testing • Geotechnical • Subsurface Investigations



SOUTHERN
EARTH SCIENCES

Built On Strong Foundations

Environmental • Construction Materials Testing • Geotechnical • Subsurface Investigations





SOUTHERN EARTH SCIENCES

Geotechnical | Environmental | Materials Testing

Proposed Baton Rouge Police Department

SIM Shooting House

Zachary, Louisiana

**Report of Subsurface Investigation
and Geotechnical Evaluation**

Prepared For:
Department of Building and Grounds – Architectural Services Division
City of Baton Rouge

Baton Rouge, Louisiana
April 29, 2024



**SOUTHERN
EARTH SCIENCES**
Geotechnical | Environmental | Materials Testing

BATON ROUGE OFFICE

11638 Sun Belt Court
Baton Rouge, LA 70809

Tel: (225) 751-1727
Fax: (225) 752-1467
www.soearth.com

April 29, 2024

**DEPARTMENT OF BUILDING AND GROUNDS – ARCHITECTURAL SERVICES DIVISION
CITY OF BATON ROUGE**

1100 Laurel Street – Room 227
Baton Rouge, Louisiana 70802

ATTENTION: Mr. Robert Gray, AIA, LEED AP BD+C

REFERENCE: Report of Subsurface Investigation and Geotechnical Engineering Evaluation
Proposed BRPD SIM Shooting House
Zachary, Louisiana
SES Project No: B24-031

Dear Mr. Delaune:

Southern Earth Sciences, Inc (SES) has completed the subsurface investigation and geotechnical engineering evaluation for the referenced project. This report presents our understanding of the available project information and outlines our soil-related recommendations and comments regarding construction of the proposed new structures and surrounding pavement areas.

We appreciate this opportunity to be of service. Please do not hesitate to contact us if you have any questions.

Sincerely,

SOUTHERN EARTH SCIENCES, INC.

Kenny Meyn, P.E.
Regional Manager
Registered, Louisiana 24945



KM

Attachments

DEPARTMENT OF BUILDING AND GROUNDS – ARCHITECTURAL SERVICES DIVISION

CITY OF BATON ROUGE

Report of Subsurface Investigation and Geotechnical Engineering Evaluation

Proposed BRPD SIM Shooting House

Zachary, Louisiana

SES Project No: B24-031

April 29, 2024

1.0	Project Information.....	- 1 -
2.0	Site Description	- 1 -
3.0	Field Investigation.....	- 1 -
4.0	Laboratory Testing Program	- 2 -
5.0	Subsurface Conditions	- 2 -
5.1	Groundwater.....	- 2 -
5.2	Presence of Expansive Soils	- 3 -
6.0	Foundation Recommendations.....	- 3 -
6.1	Site Preparation	- 3 -
6.2	Structural Fill Recommendations.....	- 4 -
6.3	Shallow Foundations.....	- 5 -
6.3.1	Building Floor Slab.....	- 6 -
6.3.2	Grade Supported Slab Precautions	- 6 -
7.0	Pavement Recommendations.....	- 7 -
7.1	Pavement Base Course	- 8 -
7.2	Alternative Base Course Options	- 8 -
7.3	Moisture Control and Drainage for Pavements.....	- 8 -
8.0	General Comments and Limitations	- 9 -

APPENDIX

Test Location Plan

CPT Sounding Logs

Soil Boring Logs

DEPARTMENT OF BUILDING AND GROUNDS – ARCHITECTURAL SERVICES DIVISION

CITY OF BATON ROUGE

Report of Subsurface Investigation and Geotechnical Engineering Evaluation

Proposed BRPD SIM Shooting House

Zachary, Louisiana

SES Project No: B24-031

April 29, 2024

1.0 PROJECT INFORMATION

Based on our understanding of the provided information, the project will consist of the design and construction of 2 new single-story structures with associated pavement areas. Based on the provided site plan, it is assumed that the new structures will encompass areas ranging from approximately 2,500 to 5,000 square feet. The proposed project site is located at 999 West Irene Road in Zachary, Louisiana.

No detailed loading, grading, and/or topographic information was available at the writing of this report; however, SES assumes that the maximum column and wall loads will not exceed 24 kips and 2.0 kips per linear foot, respectively. Furthermore, SES assumes less than two (2) feet of structural fill material will be required to achieve design grade for this project.

2.0 SITE DESCRIPTION

At the time of our fieldwork, the project site consisted of a relatively flat grass covered lot. Based on limited historical imagery from Google Earth which dates back to 1989, the site was heavily wooded up until late 2007 when it appears to have been cleared. Our scope of work did not include exploration to determine if abandoned foundations from previous development are located on the site.

3.0 FIELD INVESTIGATION

Three (3) Cone Penetrometer Test (CPT) soundings and three (3) auger boring were performed within the proposed structure and pavement areas at client determined locations. The test locations were identified in the field by SES personnel using the provided site plan and reference to onsite features. The locations were marked and recorded using a handheld GPS accurate to 25 feet. A Test Location Plan is attached in the **Appendix**.

The CPT soundings were advanced to depths of about 25 feet below existing site grades in general accordance with ASTM Specification D5778 using a track mounted Geoprobe 6625 Electronic CPT rig. CPT Log sheets graphically showing the cone tip resistance, friction, equivalent N-value and interpreted soil type at the sounding location is attached in the **Appendix**. Soil classifications were interpreted from methods recommended by Robertson and Campanella. Correlations between Cone Resistance values and Standard Penetration Testing "N" values were performed according to the methods developed by Robertson, Campanella and Wightman. The soil types and stratigraphy shown on the CPT Log sheets are based upon material parameters measured and evaluated as the cone is advanced.

The auger borings were performed to depths of about 10 feet below grade. The samples were obtained using a flight auger and were logged and bagged and identified according to project number, test location, and depth then transported to the laboratory for testing. The depths at which samples were obtained are

DEPARTMENT OF BUILDING AND GROUNDS – ARCHITECTURAL SERVICES DIVISION
CITY OF BATON ROUGE

Report of Subsurface Investigation and Geotechnical Engineering Evaluation
Proposed BRPD SIM Shooting House
Zachary, Louisiana
SES Project No: B24-031
April 29, 2024

shown on the attached soil boring logs of this report. All reference to depth has been made with respect to the existing ground surface encountered during our field investigation.

4.0 LABORATORY TESTING PROGRAM

A supplemental laboratory testing program was conducted to determine additional pertinent engineering characteristics of the subsurface materials. This program included visual description and classification and determination of the moisture content (*ASTM D2216 Standard Test Method for Laboratory Determination of Water (Moisture) Content of Soil and Rock by Mass*) on all samples. Furthermore, selected samples were subjected to Atterberg Limit Determinations (*ASTM D4318 Standard Test Methods for Liquid Limit, Plastic Limit and Plasticity Index of Soils*). The results of these tests are found in the accompanying soil boring logs located in the **Appendix**.

5.0 SUBSURFACE CONDITIONS

The following is a general description of subsurface conditions encountered during our site investigation. The descriptions provided below are brief and generalized. Additional details on soil layers and the collected data at each test location can be found on the individual CPT Sounding and Soil Boring Logs attached in the **Appendix**. All reference to depth has been made with respect to the existing ground surface encountered during our field investigation.

Subsurface soils encountered across the project site generally consist of medium stiff clays to a depth of about 20 feet, the maximum depth explored. Additional details on the collected data at each test location can be found on the individual CPT Sounding and Soil Boring Logs attached in the **Appendix**.

5.1 Groundwater

Groundwater levels were not encountered at the time of our field investigation. All test locations collapsed upon auger/rod removal at depths ranging from 2.1 to 3.2 feet below grade. Groundwater levels and the dates measured can be seen on the CPT Sounding and Soil Boring Logs in the **Appendix**.

Groundwater depths or elevations should be verified at the time of construction for cases where groundwater variations are potentially significant for construction. Fluctuation in the groundwater table will occur due to variances in rainfall, elevation, drainage, types of soil encountered and other factors not evident at the time measurements were made. Reference to depth has been made with respect to the existing ground surface encountered at the time of our field investigation. Groundwater levels encountered at each test location at the time of our investigation are shown on the appropriate CPT Sounding and Soil Boring Logs attached in the **Appendix**.

DEPARTMENT OF BUILDING AND GROUNDS – ARCHITECTURAL SERVICES DIVISION

CITY OF BATON ROUGE

Report of Subsurface Investigation and Geotechnical Engineering Evaluation

Proposed BRPD SIM Shooting House

Zachary, Louisiana

SES Project No: B24-031

April 29, 2024

5.2 Presence of Expansive Soils

Based on the laboratory test results from the soil borings, the subsurface soils encountered within the site are considered to have moderate swelling potential. Generally, the subsurface soils with swelling potential above the ground water level and within the depths subjected to moisture content changes are expected to undergo volume change behavior and were considered in our potential vertical rise (PVR) estimation. **The potential vertical rise (PVR) is estimated to be on the order of 1.0 inch using an applied load of 100 psf.** The PVR estimates were performed using the TEX 124E method analyzing the upper ten (10) feet of soil.

One (1) inch of PVR is generally accepted as the maximum allowable value for design and construction. However, the Structural Engineer or others should determine if these PVR values are within the acceptable limits. The estimated amount of vertical movement of a foundation or floor slab constructed on swelling clays is referred to as the Potential Vertical Rise (PVR). To reduce the potential for shrinkage and swelling of the site soils, it is important that consideration be given to reducing the potential for moisture changes of the site soils. As a minimum, positive drainage away from the new buildings should be provided. If positive drainage is not provided, water will pond around and/or below the structure and total and differential movements higher than indicated in this report may occur.

6.0 FOUNDATION RECOMMENDATIONS

Our evaluation of foundation conditions has been based on the project information and assumed foundation loadings previously described in this report and subsurface data obtained during the investigation. In evaluating the CPT soundings and auger borings, we have relied on our experience with similar soil conditions and the use of empirical correlations between standard penetration resistances and foundation performance observed in soil conditions similar to those encountered at the subject site.

Soils generally consisted of medium stiff clays. These soils will be suitable for support of lightly loaded structures using a traditional shallow foundation system consisting of square spread and continuous footings near existing grade, provided the allowable bearing capacity and estimated settlement is adequate.

6.1 Site Preparation

Based on our experience with similar site conditions, effective drainage, including ditching and positive grading, should be established across the working areas during the initial stages of site grading, and modified as necessary during construction. Once adequate site drainage is in place, the initial step in site preparation should be the complete removal of topsoil and organic-laden material, stumps and roots, debris, rubble, any existing abandoned foundations or pavement elements, and

DEPARTMENT OF BUILDING AND GROUNDS – ARCHITECTURAL SERVICES DIVISION
CITY OF BATON ROUGE

Report of Subsurface Investigation and Geotechnical Engineering Evaluation
Proposed BRPD SIM Shooting House
Zachary, Louisiana
SES Project No: B24-031
April 29, 2024

utilities, extending laterally to at least 5 feet outside of the construction area. Excavated materials should be wasted or stockpiled for use in non-structural areas.

Excavation depths required during the initial site preparations to ensure complete removal of all sensitive, fine grained and organic laden material will vary with location and are expected to range from 4 to 6 inches below existing grade. Excavations should extend to a depth of 24 inches below existing grade, 12 inches below the deepest footing elevation, or as needed to remove loose or unsuitable soils that cannot be improved by compaction. Any over-excavated areas should be backfilled using well-compacted structural fill material placed in horizontal lifts as described below.

The exposed subgrade in areas to support pavements, structures, or fill embankments should be proof rolled with a loaded dump truck weighing 15 to 20 tons. Proof-rolling should be performed after a suitable period of dry weather to avoid degrading an otherwise acceptable subgrade and to reduce the amount of undercutting/remedial work required. Any areas that deflect excessively under the equipment and do not stabilize with further compaction should be lowered further by excavation until more stable material is reached.

Excavations made as part of the undercutting or foundation construction should remain open for the least amount of time practical. If soils at the bottom of the excavation are disturbed, saturated, or otherwise become unstable, the excavation should be extended deeper to stable materials. Care should be taken to ensure that any soft or excessively yielding areas are undercut to firmer materials. Any demolished pavements and other debris should be disposed of offsite. Since the lateral and vertical extent may vary, we recommend the excavation and backfilling operation be observed by an experienced soils technician under the direct supervision of the registered project geotechnical engineer of record.

6.2 Structural Fill Recommendations

Fill material should be compacted in 8-inch (maximum) lifts to at least 95 percent of the soil's standard proctor maximum dry density as determined by ASTM D 698. In place density tests should be made at frequent intervals to measure the effectiveness of the compaction operations.

Samples of candidate fill material should be submitted to SES prior to construction to verify that the fill material is suitable for use as structural fill and to establish compaction moisture-density relationships for use as reference for the field density testing.

Imported structural fill material shall be an inert material (non-expansive soil), free of organics (<5%) with a maximum particle size of 2 inches. Commonly available acceptable fill for this region are pumped river sand, lean clays, or clayey sands having the following material properties:

DEPARTMENT OF BUILDING AND GROUNDS – ARCHITECTURAL SERVICES DIVISION

CITY OF BATON ROUGE

Report of Subsurface Investigation and Geotechnical Engineering Evaluation

Proposed BRPD SIM Shooting House

Zachary, Louisiana

SES Project No: B24-031

April 29, 2024

TABLE 1: STRUCTURAL FILL PARAMETERS

Soil Type	USCS Classification	Acceptance Criteria
Lean Clay	CL	Liquid Limit less than 40, Plasticity Index between 12 and 22
Pumped River Sand	SP or SP-SM	Less than 10% passing the %200 Sieve
Aggregate Base	GP	LADOTD 610 Crushed Limestone or other similarly graded recycled aggregate

6.3 Shallow Foundations

After site preparation operations have been completed as previously discussed, shallow footings bearing at least 18 inches below surrounding grade may be designed for an allowable soil bearing pressure of 1,500 psf. Minimum footing widths of 18 and 24 inches for strip and column footings, respectively, should be observed. Soils exposed in the bottom of footing excavations should consist of medium stiff in-situ soils or acceptable structural fill compacted to a minimum of 95 percent of the standard Proctor maximum dry density to a depth of at least 12 inches below the footing bearing elevation. The bottom of all footing excavations should be observed by an SES engineering technician. Any footing areas found to contain unsuitable materials, poorly compacted soils, or soils that have become softened due to exposure to weather should be undercut and backfilled with new well-compacted structural fill prior to footing construction.

Total settlements for square spread footings up to four (4) feet and continuous footings up to two (2) feet in width and placement of up to two (2) feet of fill material are expected to be less than one (1) inch. Differential settlements can be assumed to be approximately 50% of the total settlement. Settlement was estimated based on the total sustained dead loads of 70% of the above recommended net allowable bearing capacities plus up to two (2) feet of structural fill material, using empirical correlations between CPT data and compressibility. The Structural Engineer shall confirm if these magnitudes are within tolerance limits. If not, SES shall be notified in order to provide some remedial measures and/or change the foundation type.

The bottom of the foundation excavations must be dry, clean and free of loose, soft materials and construction debris prior to placement of steel or concrete. The foundation excavations should be observed by SES’s Geotechnical Engineer or their representative prior to steel or concrete placement. Concrete shall be poured as quickly as possible to avoid exposure of the footing materials to moisture changes (wetting or drying). Surface run-off water should be channeled away from the excavation and not be allowed to pond. If for any reason the excavation is required to be open for more than one (1) day, it shall be protected to minimize moisture loss/gain.

DEPARTMENT OF BUILDING AND GROUNDS – ARCHITECTURAL SERVICES DIVISION

CITY OF BATON ROUGE

Report of Subsurface Investigation and Geotechnical Engineering Evaluation

Proposed BRPD SIM Shooting House

Zachary, Louisiana

SES Project No: B24-031

April 29, 2024

6.3.1 Building Floor Slab

We recommend that a slab-on-grade design can be used to support the building floor slab assuming the site is prepared as described in section 6.1 of this report.

In order to assist with drainage and to increase the modulus of subgrade reaction (k value), a four (4) inch thick free-draining granular mat may be used. The soil surface shall be graded to drain away from the building without low spots that can trap water prior to placing the granular drainage layer. Polyethylene sheeting should be placed to act as a vapor retarder where the floor will be in contact with moisture sensitive equipment or products such as tile, wood, carpet, etc., as directed by the design engineer. The decision to locate the vapor retarder in direct contact with the slab or beneath the layer of granular fill should be made by the design engineer after considering the moisture sensitivity of subsequent floor finishes, anticipated project conditions, and the potential effects of slab curling and cracking. The floor slabs should have an adequate number of joints to reduce cracking resulting from differential movement and shrinkage.

For slabs bearing on properly proof rolled subgrade or at least 12 inches of compacted structural fill, a modulus of subgrade reaction (k value) of 110 pounds per cubic inch (pci) may be used in the grade slab design. If a four (4) inch granular layer is used, a modulus of subgrade reaction (k value) of 130 pounds per cubic inch (pci) may be used.

6.3.2 Grade Supported Slab Precautions

The precautions listed below are for informational purposes for the construction of traditional slab-on-grade pads. These details will not reduce the amount of movement but are intended to reduce potential damage should some settlement of the supporting subgrade take place. Some increase in moisture content is inevitable as a result of development and associated landscaping. However, extreme moisture content increases can be largely controlled by proper and responsible site drainage, building maintenance and irrigation practices.

Cracking of slab-on-grade concrete is normal and should be expected. Cracking can occur not only as a result of heaving or compression of the supporting soil material, but also as a result of concrete curing stresses. The occurrence of concrete shrinkage cracks and problems associated with concrete curing may be reduced and/or controlled by limiting the slump of the concrete, proper concrete placement, finishing, and curing, and by the placement of crack control joints at frequent intervals, particularly where re-entrant slab corners occur. The American Concrete Institute (ACI) recommends a maximum panel size (in feet) equal to approximately three times the thickness of the slab (in inches) in both directions. For example, joints are recommended at a maximum spacing of twelve (12) feet based on having a four-inch slab. SES also recommends that

DEPARTMENT OF BUILDING AND GROUNDS – ARCHITECTURAL SERVICES DIVISION

CITY OF BATON ROUGE

Report of Subsurface Investigation and Geotechnical Engineering Evaluation

Proposed BRPD SIM Shooting House

Zachary, Louisiana

SES Project No: B24-031

April 29, 2024

the slab be independent of the foundation walls. Using fiber reinforcement in the concrete can also control shrinkage cracking.

Areas supporting slabs should be properly moisture conditioned and compacted. Backfill in all interior and exterior water and sewer line trenches should be carefully compacted to reduce the shear stress in the concrete extending over these areas.

Exterior slabs should be isolated from the building. These slabs should be reinforced to function as independent units. Movement of these slabs should not be transmitted to the building foundation or superstructure.

7.0 PAVEMENT RECOMMENDATIONS

Recommendations for pavement areas are based on laboratory testing performed at the proposed project site and typical vehicular traffic characteristics for a project of this type. These typical minimum pavement sections are based on our experience with similar project assuming mostly passenger vehicle traffic.

Site preparation for parking and drive areas should generally be the same as outlined in Section 6.1 to include complete removal of topsoil, organics, tree root systems, debris, rubble, any existing abandoned foundations or pavement elements, utilities, etc. Tables 2 and 3 outline the minimum recommended pavement section for both rigid and flexible pavement design.

Based on our empirical analysis from field results, a Modulus of Subgrade Reaction (k) of 110 pci should be assigned to the near surface soils. With these assumptions, it is possible to use a typical “standard” pavement section consisting of the following:

TABLE 2: RECOMMENDED MINIMUM RIGID PAVEMENT SECTION

Paved Area	Aggregate Base	Concrete ¹ (4000 psi)
Automobile Parking Areas/Standard Duty Drives (passenger vehicles)	8 inches	6 inches
Medium Duty Drives (10,000lb single axle)	8 inches	7 inches
Heavy Duty Drives (18-wheeler, maneuvering areas, dumpster pads)	8 inches	8 inches

1. Proper finishing of concrete pavement requires the use of appropriate construction joints to reduce cracking. Construction joints shall be designed in accordance with the current Portland Cement Association and the American Concrete Institute guidelines (ACI330R-08). Joints should be sealed to reduce the potential for water infiltration into the supporting soils. The design of steel reinforcement should be in accordance with current accepted codes.

DEPARTMENT OF BUILDING AND GROUNDS – ARCHITECTURAL SERVICES DIVISION

CITY OF BATON ROUGE

Report of Subsurface Investigation and Geotechnical Engineering Evaluation

Proposed BRPD SIM Shooting House

Zachary, Louisiana

SES Project No: B24-031

April 29, 2024

TABLE 3: RECOMMENDED MINIMUM FLEXIBLE PAVEMENT SECTION

Paved Area	Aggregate Base	Asphalt Surface and Binder
Automobile Parking	8 inches	3 inches
Standard Duty Drives (passenger vehicles)	8 inches	4 inches
Medium Duty Drives (10,000lb single axle)	8 inches	5 inches

7.1 Pavement Base Course

Pavement materials may be placed after the subgrade or structural fill has been properly proof rolled, compacted, and fine-graded. Aggregate base should consist of 610 Limestone or other approved base course Class II base course compacted to at least 95 percent of maximum dry density near the optimum moisture content in accordance with ASTM D698.

Aggregate sections shown for concrete pavement are not required for support, but is recommended to reduce potential for slab curl, shrinkage cracking, and deterioration of subgrade by improving drainage beneath the slab.

7.2 Alternative Base Course Options

As an alternative to the aggregate base shown in Tables 2 and 3, 10-12 inches of lime and/or cement stabilized fill prepared in accordance with Section 305 of the 2016 LSSRB can be substituted for compacted fill and aggregate base. Actual cement and lime addition rates should be based on classification testing performed on actual fill at time of construction in accordance with Section 305.04(a).

7.3 Moisture Control and Drainage for Pavements

One of the most destructive elements that pavement will be subjected to in its design lifetime is the presence of excess moisture. Therefore, pavements should be adequately sloped, and sufficient drainage provided such that excess water is allowed to run off before it can migrate into the pavement system. Sprinkler systems, if utilized in landscaped areas, should be properly installed and aimed such that they do not continually wet the paved surfaces.

**DEPARTMENT OF BUILDING AND GROUNDS – ARCHITECTURAL SERVICES DIVISION
CITY OF BATON ROUGE**

Report of Subsurface Investigation and Geotechnical Engineering Evaluation
Proposed BRPD SIM Shooting House
Zachary, Louisiana
SES Project No: B24-031
April 29, 2024

8.0 GENERAL COMMENTS AND LIMITATIONS

While the CPT soundings and auger borings are representative of subsurface conditions at the respective locations and for the respective vertical reaches, local variations characteristic of the subsurface materials of the region are anticipated and may be encountered. The delineation between soil types shown on the logs are approximate and the description represents our interpretation of subsurface conditions at the designated testing location and on the particular date performed.

This report has been prepared in order to aid in the evaluation of this project and to assist the engineers in the structural design. It is intended for use with regard to the specific project discussed herein and any substantial changes in the project, loads, locations, or assumed grades should be brought to our attention so that we may determine how such changes may affect our conclusions and recommendations. We would appreciate the opportunity to review the plans and specifications for construction to ensure that our conclusions and recommendations are interpreted correctly.

Professional judgments on design alternatives and criteria are presented in this report. These are based partly on our evaluations of technical information gathered, partly on our understanding of the characteristics of the project being planned, and partly on our general experience with subsurface conditions in the area. We do not guarantee performance of the project in any respect, only that our engineering work and judgments rendered meet the standard of care of our profession.

As the project geotechnical engineer of record that developed the foundation design recommendations, please be aware that we cannot accept responsibility for the performance of the foundation system if we are not afforded the opportunity to confirm that our recommendations have been followed. Accordingly, we recommend that Southern Earth Sciences, Inc. be retained on this project to perform observation and field-testing services during the construction phase of the foundation system.

This report is exclusively for the use and benefit of the addressee(s) identified on the first page of this report and is not for the use or benefit of, nor may it be relied upon by any other person or entity. The contents of this report may not be quoted in whole or in part or distributed to any person or entity other than the addressee(s) hereof without, in each case, advanced written consent.

DEPARTMENT OF BUILDING AND GROUNDS – ARCHITECTURAL SERVICES DIVISION

CITY OF BATON ROUGE

Report of Subsurface Investigation and Geotechnical Engineering Evaluation

Proposed BRPD SIM Shooting House

Zachary, Louisiana

SES Project No: B24-031


April 29, 2024

APPENDIX

Test Location Plan

CPT Sounding Logs

Soil Boring Logs

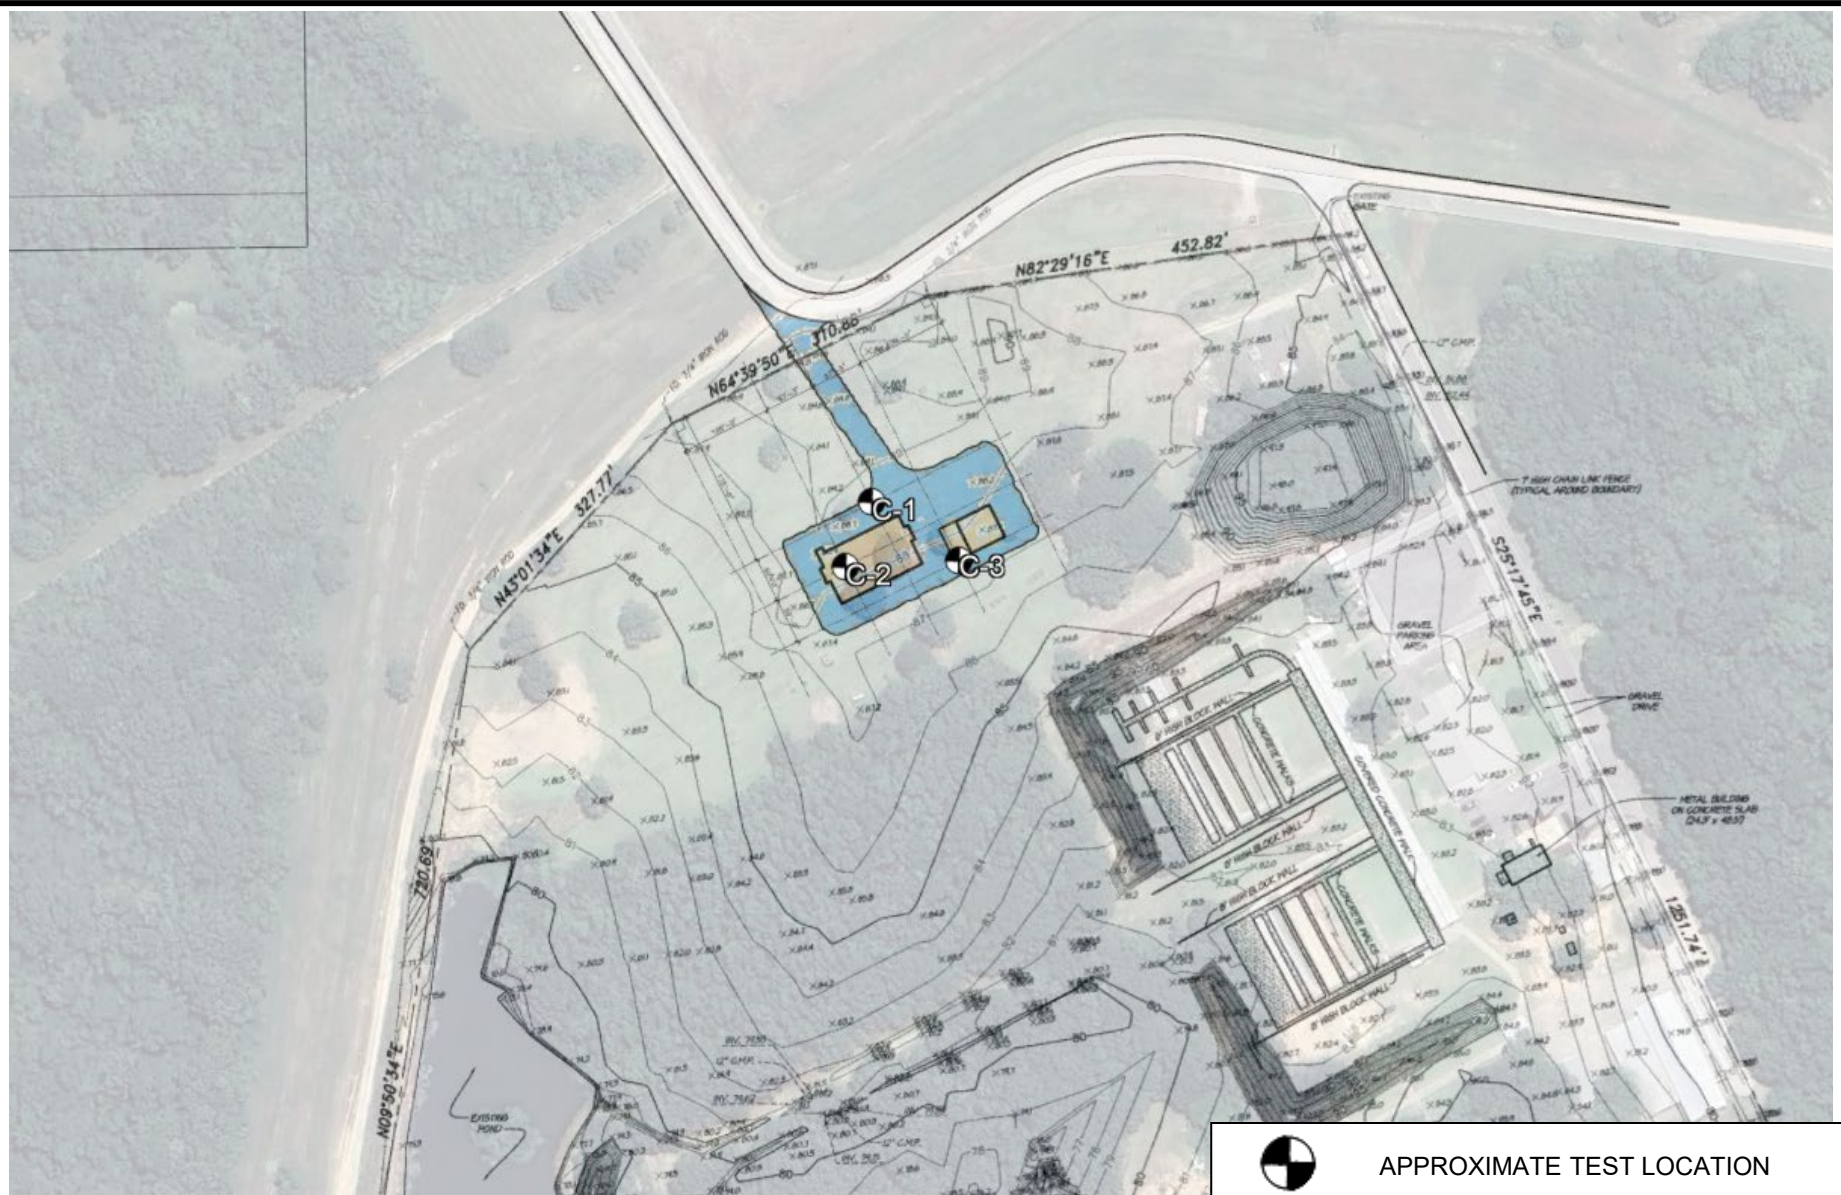

APPROXIMATE TEST LOCATION



PROPOSED BATON ROUGE POLICE
DEPARTMENT SIM SHOOTING HOUSE
ZACHARY, LOUISIANA
SESI FILE NO.: B24-031



**SOUTHERN
EARTH SCIENCES**
Geotechnical | Environmental | Materials Testing


FIGURE 1
TEST LOCATION PLAN



OPERATOR: JOSH LEE
 TOTAL DEPTH: 20.833 ft
 CONE ID: DSG1034
 GPS : 30.609094° N ;-91.234563° W

C-1

TEST DATE: 4/10/2024 10:19:11 AM
 LOCATION: BR POLICE DEPT. SHOOT
 JOB NUMBER: B24-031

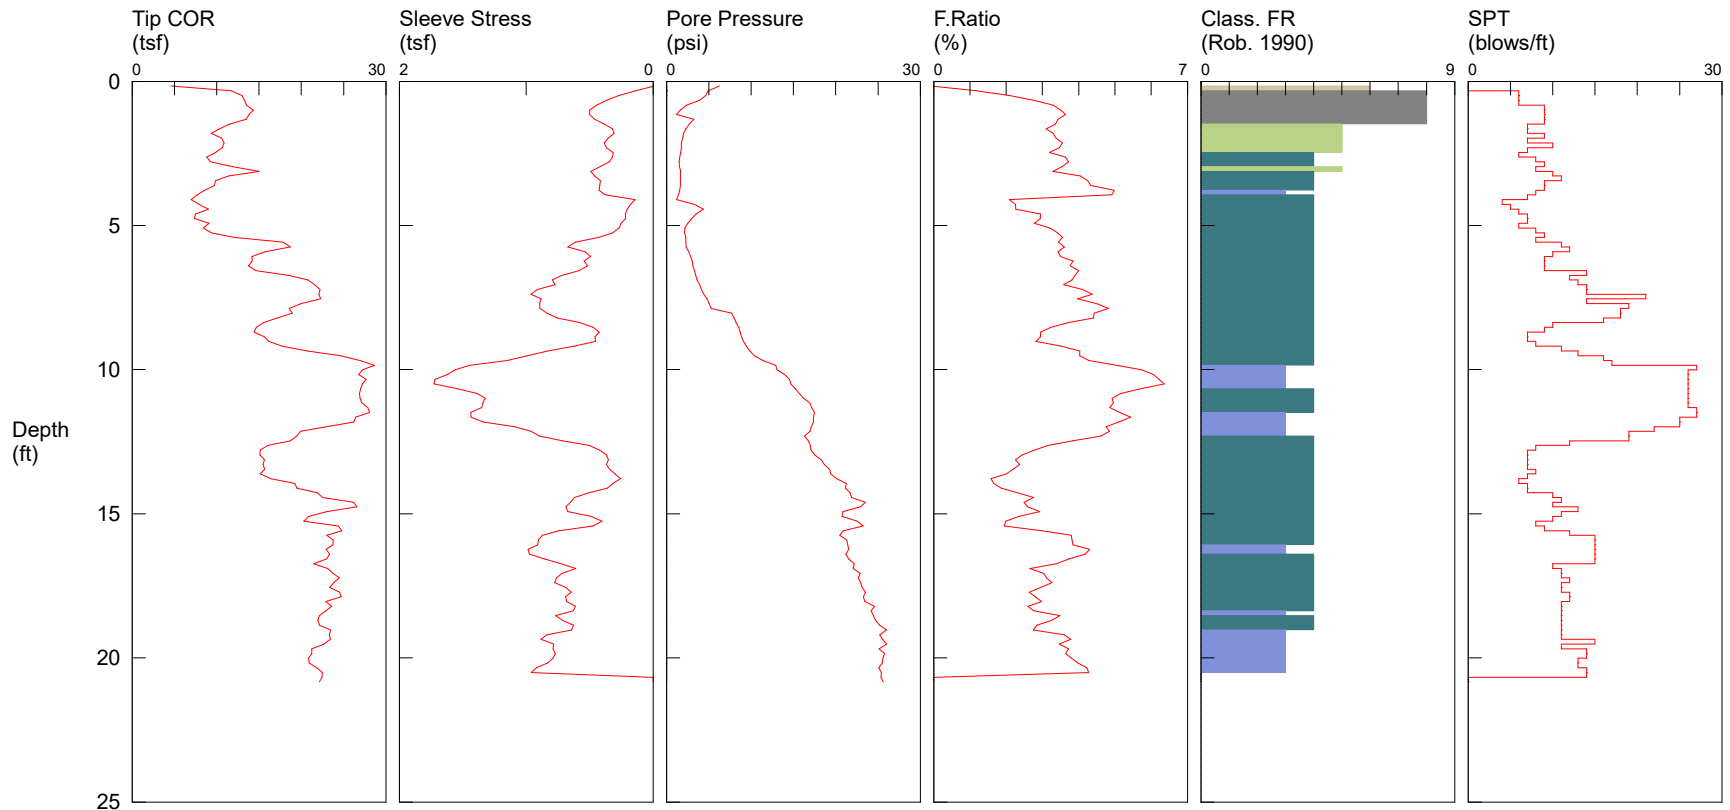

- | | | |
|---|--|--|
| <ul style="list-style-type: none"> ■ 1 Sensitive, fine grained ■ 2 Organic soils - peats ■ 3 Clays - clay to silty clay | <ul style="list-style-type: none"> ■ 4 Silt mixtures - clayey silt to silty clay ■ 5 Sand mixtures - silty sand to sandy silt ■ 6 Sands - clean sand to silty sand | <ul style="list-style-type: none"> ■ 7 Gravelly sand to sand ■ 8 Very stiff sand to clayey sand ** ■ 9 Very stiff, fine grained ** |
|---|--|--|


*SBT: Robertson 1990; **Overconsolidated or Cemented; *SBT/SPT CORRELATION: UBC-1983

C-2



OPERATOR: JOSH LEE
 TOTAL DEPTH: 20.669 ft
 CONE ID: DSG1034
 GPS : 30.608902° N ; -91.234653° W

TEST DATE: 4/10/2024 10:02:04 AM
 LOCATION: BR POLICE DEPT. SHOOT
 JOB NUMBER: B24-031

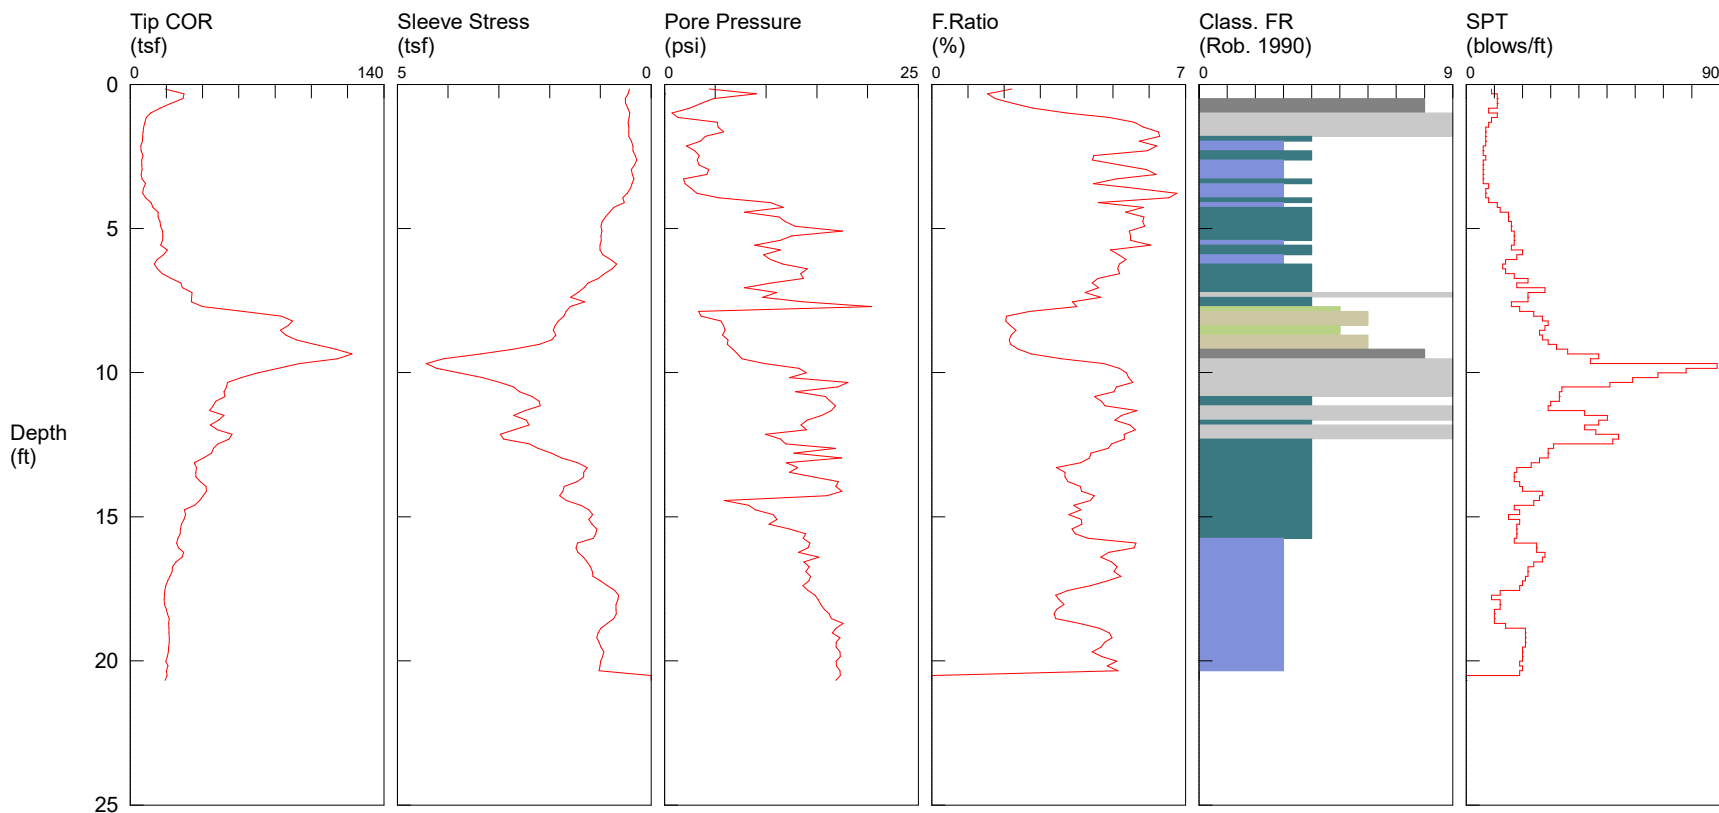

- | | | |
|---|--|--|
| <ul style="list-style-type: none"> ■ 1 Sensitive, fine grained ■ 2 Organic soils - peats ■ 3 Clays - clay to silty clay | <ul style="list-style-type: none"> ■ 4 Silt mixtures - clayey silt to silty clay ■ 5 Sand mixtures - silty sand to sandy silt ■ 6 Sands - clean sand to silty sand | <ul style="list-style-type: none"> ■ 7 Gravelly sand to sand ■ 8 Very stiff sand to clayey sand ** ■ 9 Very stiff, fine grained ** |
|---|--|--|


*SBT: Robertson 1990; **Overconsolidated or Cemented; *SBT/SPT CORRELATION: UBC-1983

C-3



OPERATOR: JOSH LEE
 TOTAL DEPTH: 20.669 ft
 CONE ID: DSG1034
 GPS : 30.608920° N ; -91.234265° W

TEST DATE: 4/10/2024 11:14:24 AM
 LOCATION: BR POLICE DEPT. SHOOT
 JOB NUMBER: B24-031

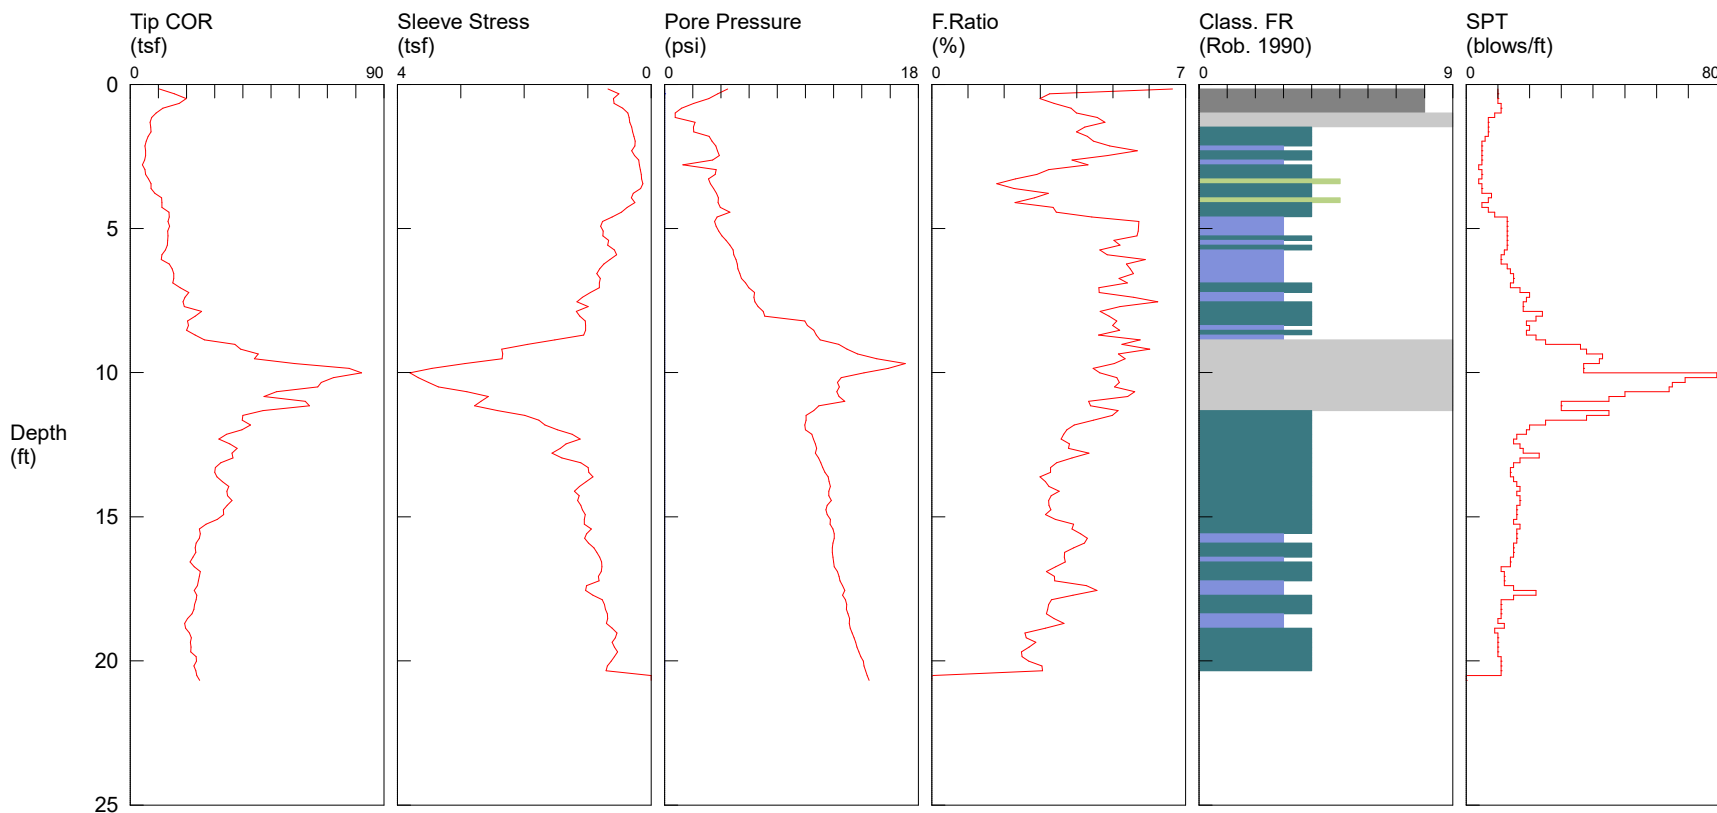



- | | | |
|---|--|---|
| <ul style="list-style-type: none"> ■ 1 Sensitive, fine grained ■ 2 Organic soils - peats ■ 3 Clays - clay to silty clay | <ul style="list-style-type: none"> ■ 4 Silt mixtures - clayey silt to silty clay ■ 5 Sand mixtures - silty sand to sandy silt ■ 6 Sands - clean sand to silty sand | <ul style="list-style-type: none"> ■ 7 Gravelly sand to sand ■ 8 Very stiff sand to clayey sand ** ■ 9 Very stiff, fine grained ** |
|---|--|---|

*SBT: Robertson 1990; **Overconsolidated or Cemented; *SBT/SPT CORRELATION: UBC-1983

BORING LOG

BORING NO.: C-1
PROJECT: PROPOSED BRPD SIM SHOOTING HOUSE
PROJECT LOCATION: ZACHARY, LA
BORING LOCATION: 30.609094° N ; -91.234563° W
BORING ELEVATION: EXISTING GRADE
GEOL/ENGR: KM
METHOD: AUGER

PROJECT NO.: B24-031
DATE DRILLED: 04/10/24
DATE COMPLETED: 04/10/24
DEPTH TO WATER LEVEL: NE
WATER LEVEL DATE: 04/10/24
LOGGED BY: GH
DRILLER: SESI

DEPTH (FEET)	SAMPLE	Moisture Content (%)	LL	PI	SYMBOL	MATERIAL CLASSIFICATION
1		22	44	27		Tan Lean CLAY w/ organics (CL)
2						Tan and Brown Lean CLAY (CL)
3		23				
4						
5						Medium Brown Fat CLAY (CH)
6		26	52	32		
7						
8						
9		26				
10						Bottom at 10 Feet
11						
12						
13						
14						
15						

COMMENTS: NE - NOT ENCOUNTERED

 AUGER

BORING LOG

BORING NO.: C-2
PROJECT: PROPOSED BRPD SIM SHOOTING HOUSE
PROJECT LOCATION: ZACHARY, LA
BORING LOCATION: 30.608902° N ; -91.234653° W
BORING ELEVATION: EXISTING GRADE
GEOL/ENGR: KM
METHOD: AUGER

PROJECT NO.: B24-031
DATE DRILLED: 04/10/24
DATE COMPLETED: 04/10/24
DEPTH TO WATER LEVEL: NE
WATER LEVEL DATE: 04/10/24
LOGGED BY: GH
DRILLER: SESI

DEPTH (FEET)	SAMPLE	Moisture Content (%)	LL	PI	SYMBOL	MATERIAL CLASSIFICATION
1		23			[Green diagonal hatching]	Tan Lean CLAY w/ organics (CL)
2						Tan and Brown Lean CLAY (CL)
3		25	48	29	[Green diagonal hatching]	
4						
5						Medium Brown Fat CLAY (CH)
6		27			[Green diagonal hatching]	
7						
8						
9		27	54	35		
10						Bottom at 10 Feet
11						
12						
13						
14						
15						



COMMENTS: NE - NOT ENCOUNTERED

AUGER

BORING LOG

BORING NO.: C-3
PROJECT: PROPOSED BRPD SIM SHOOTING HOUSE
PROJECT LOCATION: ZACHARY, LA
BORING LOCATION: 30.608920° N ; -91.234265° W
BORING ELEVATION: EXISTING GRADE
GEOL/ENGR: KM
METHOD: AUGER

PROJECT NO.: B24-031
DATE DRILLED: 04/10/24
DATE COMPLETED: 04/10/24
DEPTH TO WATER LEVEL: NE
WATER LEVEL DATE: 04/10/24
LOGGED BY: GH
DRILLER: SESI

DEPTH (FEET)	SAMPLE	Moisture Content (%)	LL	PI	SYMBOL	MATERIAL CLASSIFICATION
1		20	46	25		Tan Lean CLAY w/ organics (CL)
2						Tan and Brown Lean CLAY (CL)
3		22				
4						
5						Medium Brown Fat CLAY (CH)
6		24	55	34		
7						
8		25				
9						
10						Bottom at 10 Feet
11						
12						
13						
14						
15						

COMMENTS: NE - NOT ENCOUNTERED

 AUGER



**SOUTHERN
EARTH SCIENCES**
Geotechnical | Environmental | Materials Testing

Baton Rouge, LA 225-356-4355

Kenny Meyn, P.E.—Regional Manager
kmeyn@soearth.com

Danny Keller—Department Manager
dkeller@soearth.com

Barry Keller—Project Manager
bkeller@soearth.com

CONSTRUCTION MATERIALS TESTING

Full Range of Services and Unparalleled Response

Southern Earth Sciences, Inc. laboratories are certified by AASHTO, AMRL, CMEC and the U.S. Army Corps of Engineers to perform soil, concrete, asphalt and materials testing. Our professional inspectors and technicians continually participate in proficiency testing programs to ensure internal quality control.

FIELD TESTING AND INSPECTION

In addition to our laboratory testing facilities, SESI maintains a fully outfitted mobile field laboratory available for on-site testing. This allows our OSHA safety certified technicians to perform both call-out services on small projects or full-time quality control testing and inspection on major projects. The on-site testing lab offers a full range of services.

Services

- Dipstick technology for flatness testing of concrete slabs
- Soil testing—compaction, pile load testing, pile and caisson inspection, plate load bearing tests
- Asphaltic concrete testing—core density and thickness, evaluation of aggregates, mix designs, plant and field control
- Portland cement concrete—batch plant and field control, core drilling, molding, curing and testing cylinders
- Slump testing, air content and unit weight
- Pipe and block inspection
- Soundness and abrasion of aggregates
- Bridge inspection
- Pile integrity testing
- Pile dynamic analysis (PDA)
- Vibration monitoring
- Rebar location/depth of cover
- Post tensioning inspection
- Welding and steel framing inspections



LABORATORY TESTING OF MATERIALS

Strategically located laboratories make testing of soils, concrete, asphalt and metals quick and convenient. Branch managers supervise all lab operations in accordance with ASTM Specifications E-329 and E-699. All equipment is calibrated annually to ensure accurate data. SESI technicians are certified by appropriate accrediting agencies on a routine basis.

Services

- Consolidation testing
- Flexible wall permeability testing
- Triaxial testing
- Soil classification testing
- Concrete strength testing
- Steel strength testing



Environmental • Construction Materials Testing • Geotechnical • Subsurface Investigations

Environmental • Construction Materials Testing • Geotechnical • Subsurface Investigations





SOUTHERN
EARTH SCIENCES


SoEarth.com

Environmental • Construction Materials Testing • Geotechnical • Subsurface Investigations


Environmental • Construction Materials Testing • Geotechnical • Subsurface Investigations

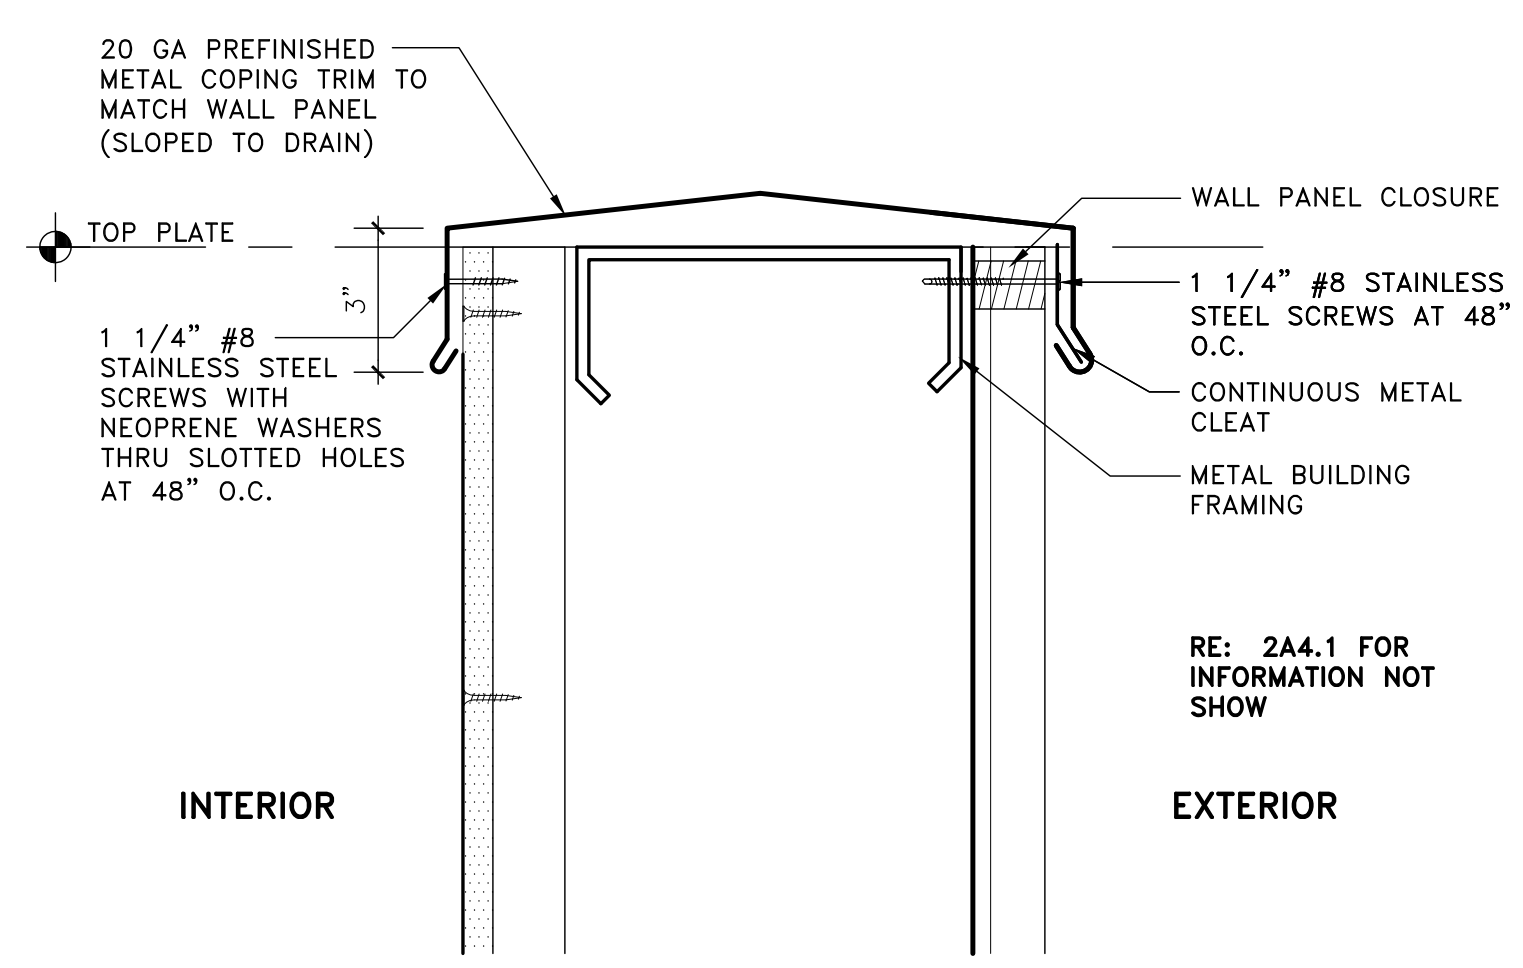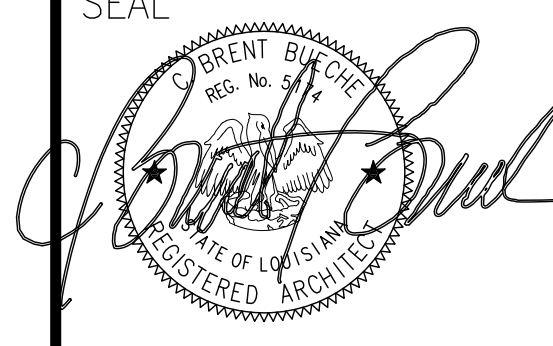


1 TOP OF EXTERIOR WALL
 3" = 1'-0"

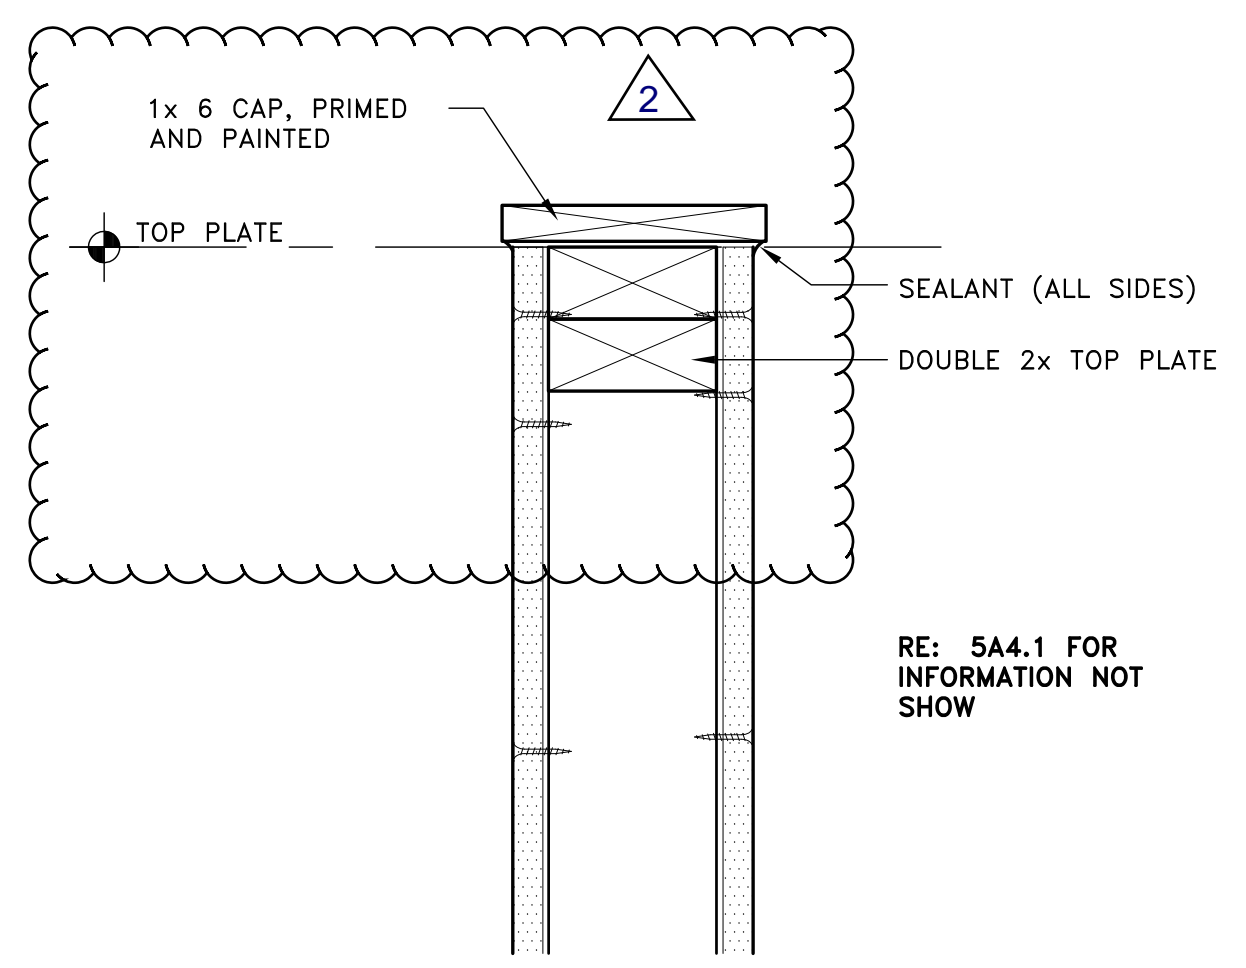


4 TOP OF INTERIOR WALL
 3" = 1'-0"

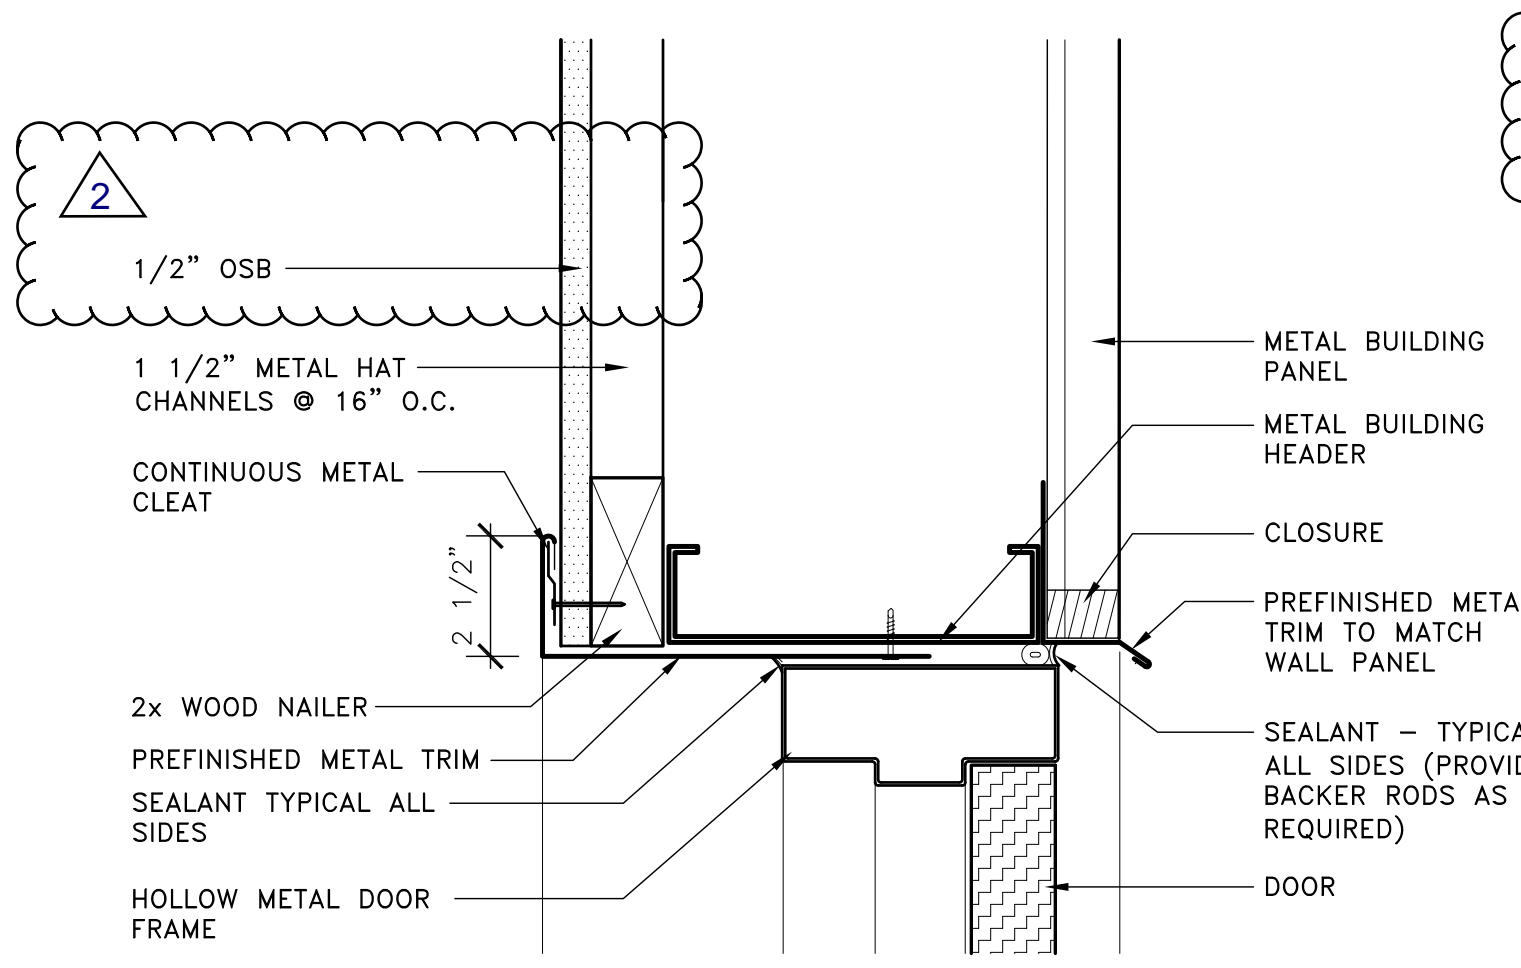


7 EXTERIOR DOOR HEAD
 3" = 1'-0"

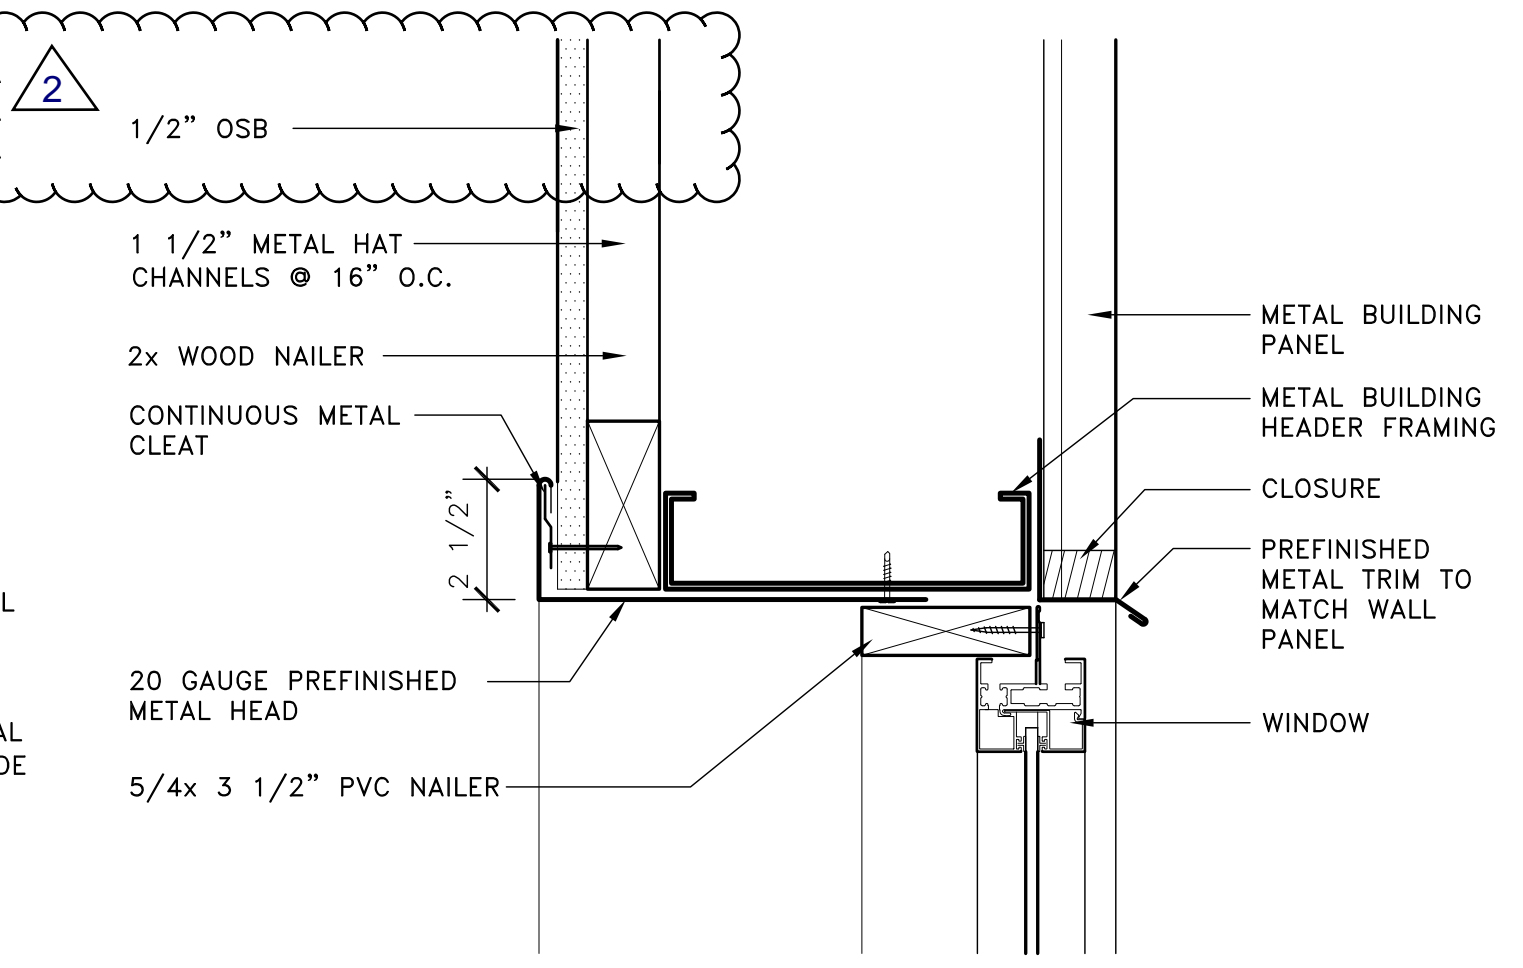


10 WINDOW HEAD
 3" = 1'-0"

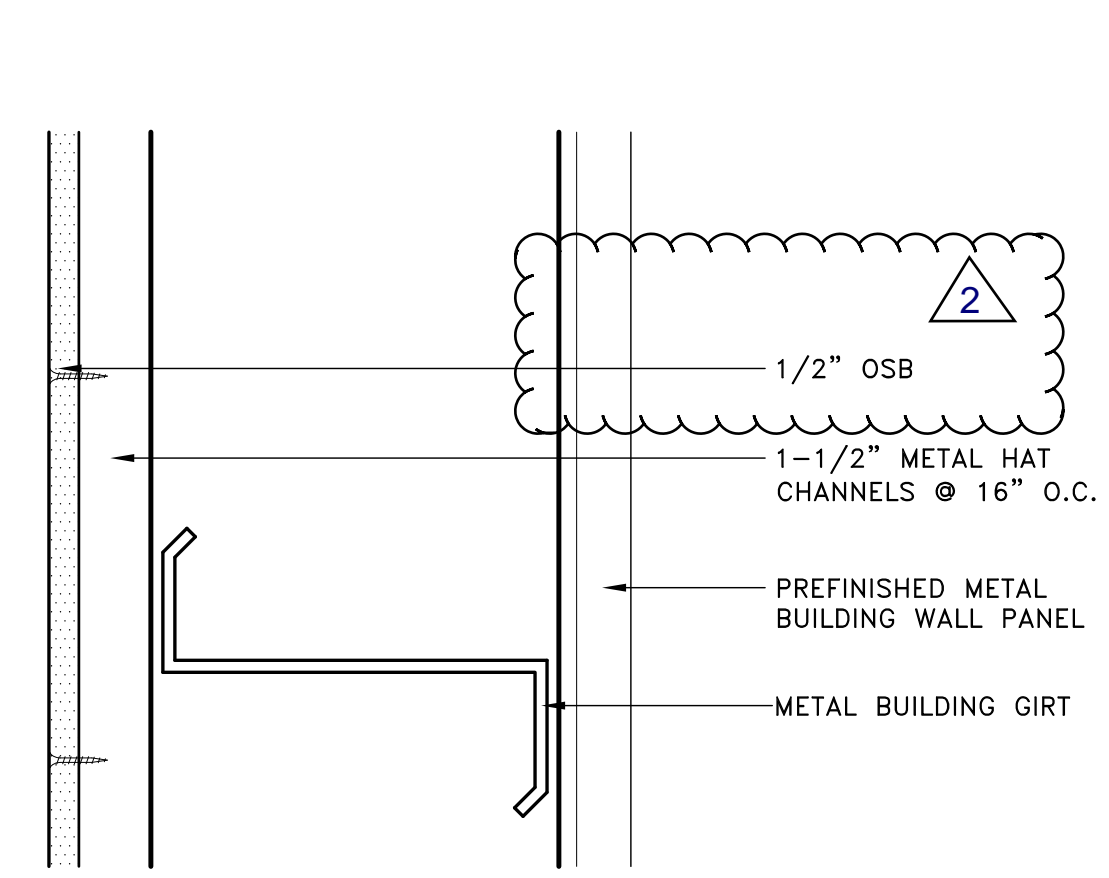


2 EXTERIOR WALL
 3" = 1'-0"

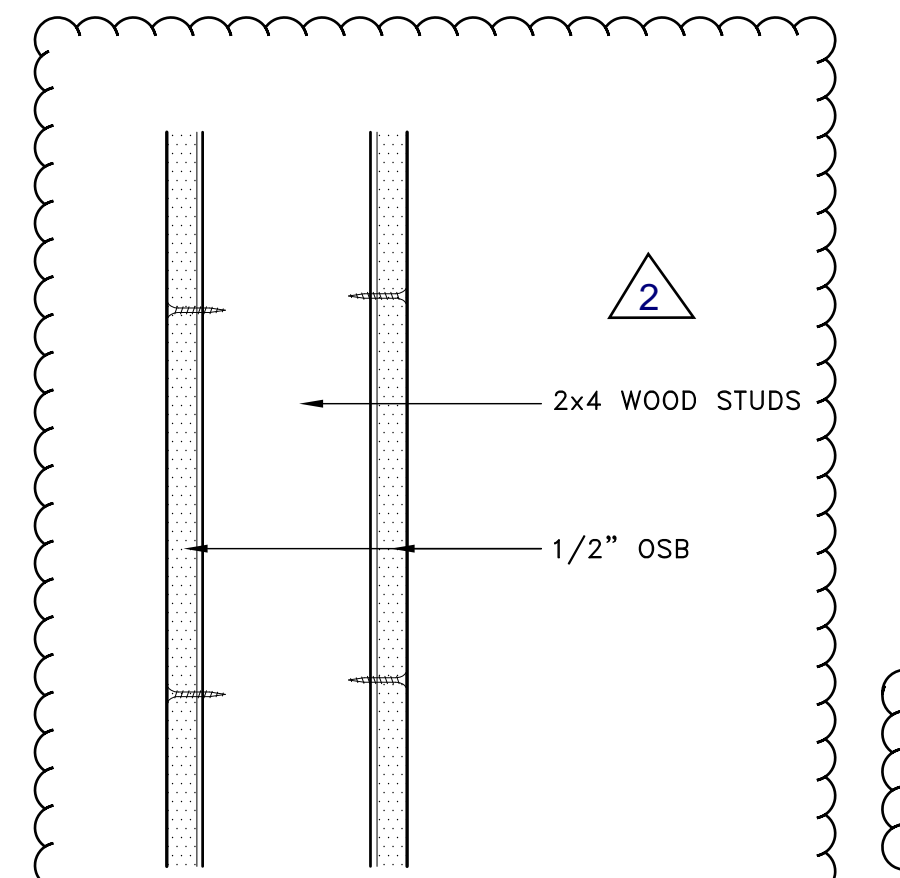


5 INTERIOR WALL
 3" = 1'-0"

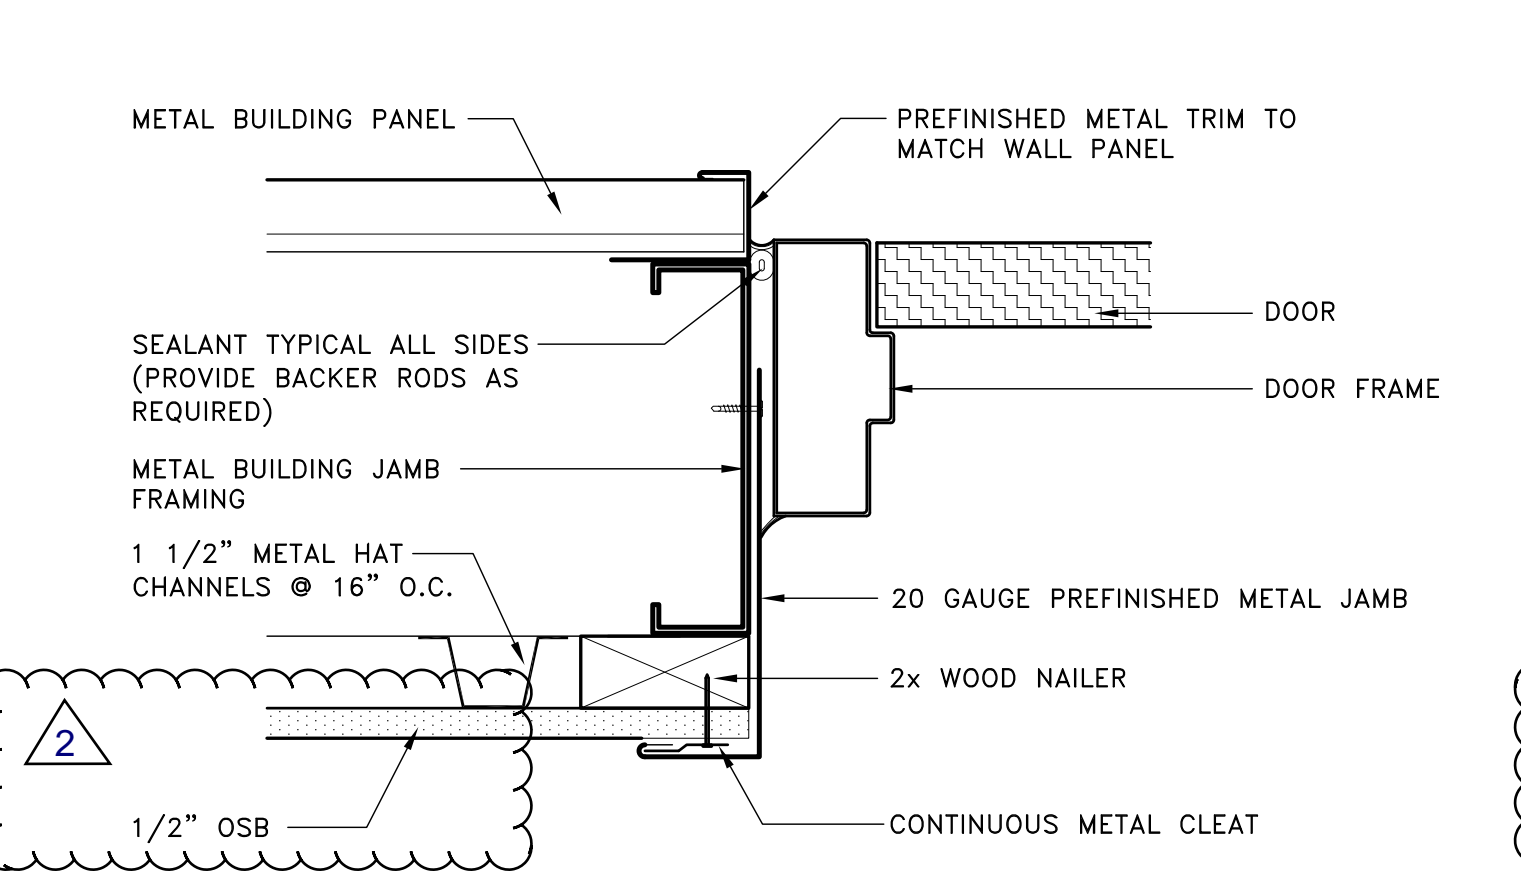


8 EXTERIOR DOOR JAMB
 3" = 1'-0"

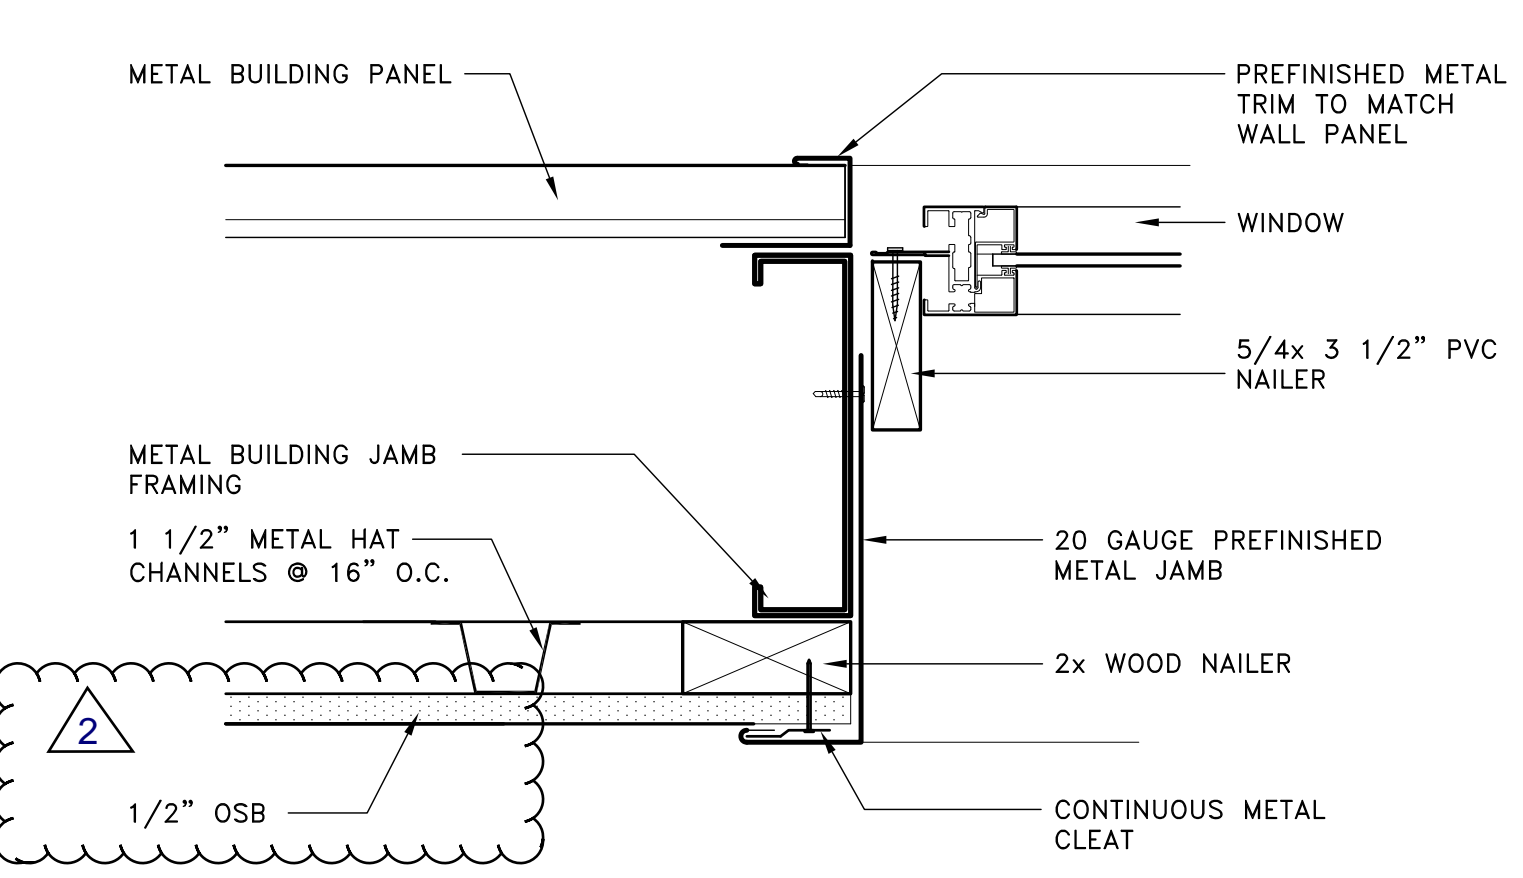


11 WINDOW JAMB
 3" = 1'-0"

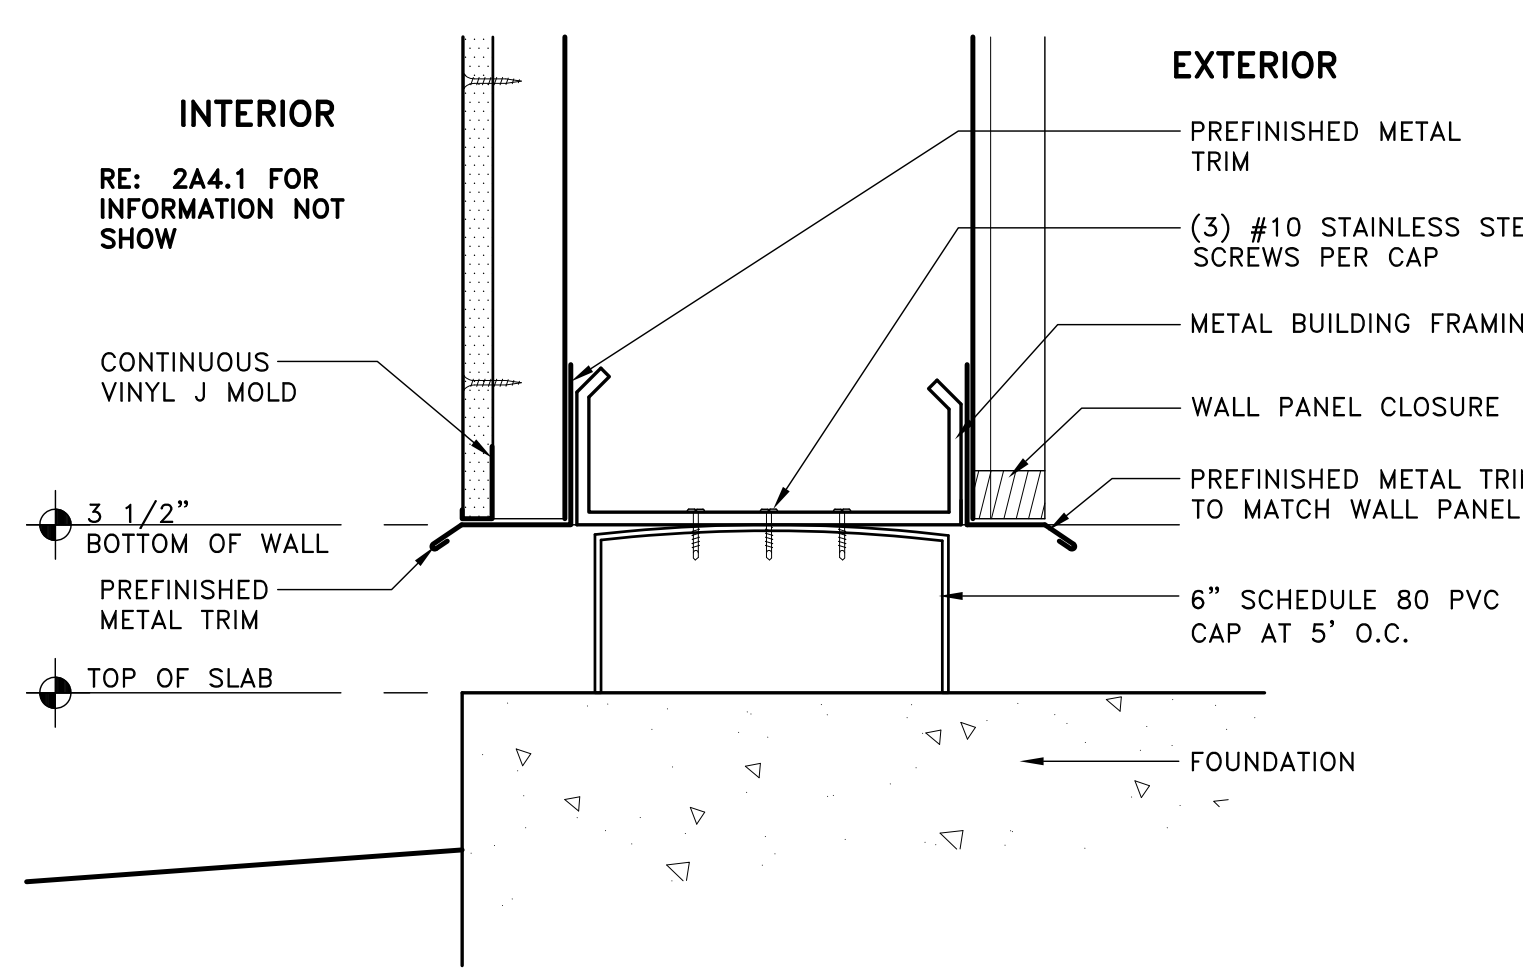


3 EXTERIOR WALL BASE
 3" = 1'-0"

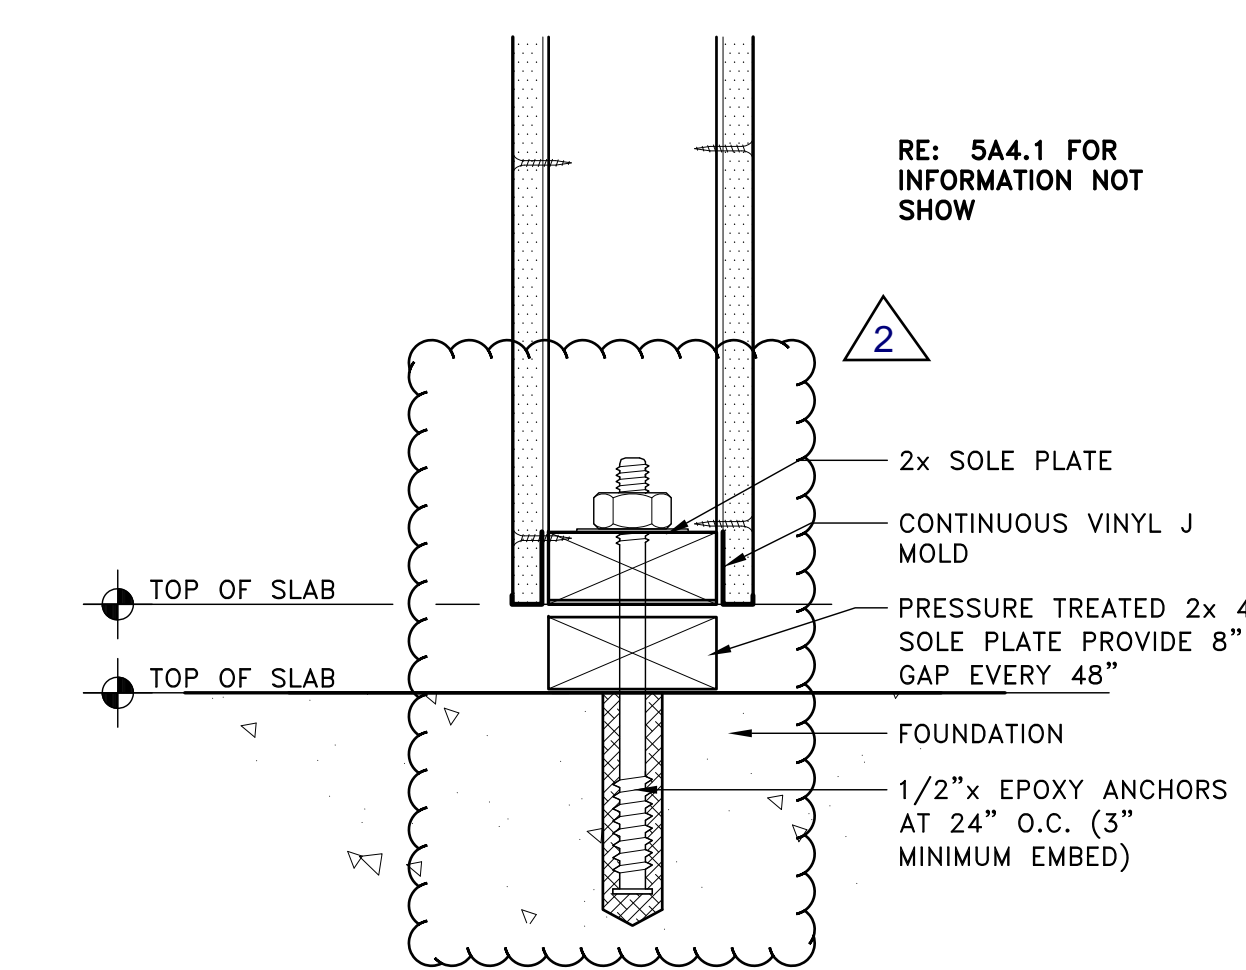

6 INTERIOR WALL BASE
 3" = 1'-0"

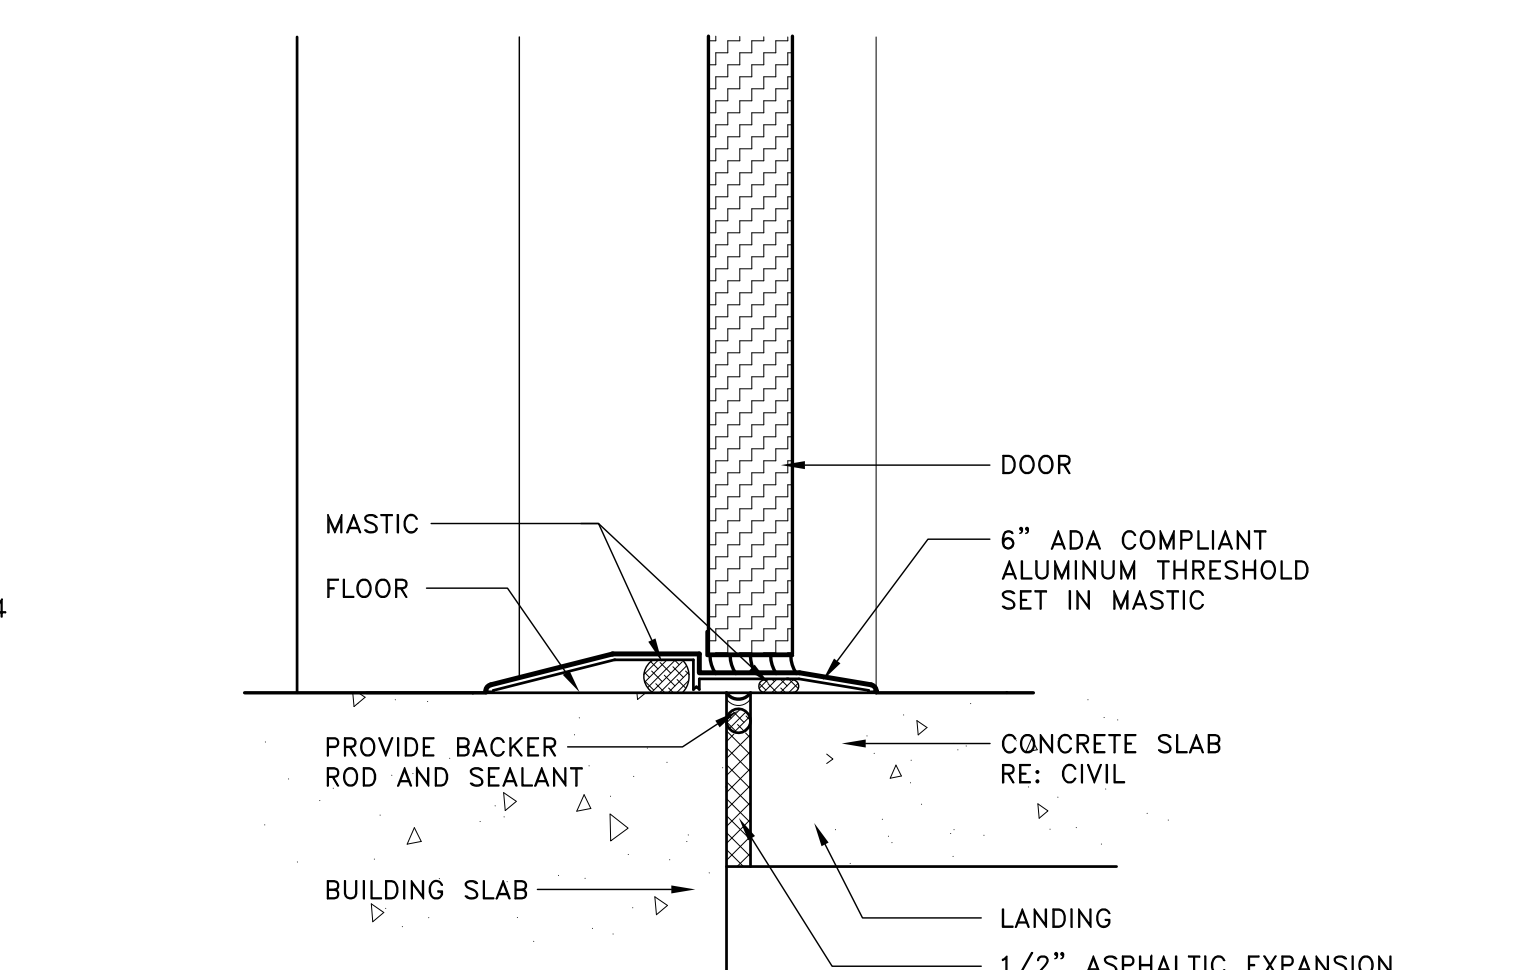

9 EXTERIOR DOOR BASE
 3" = 1'-0"

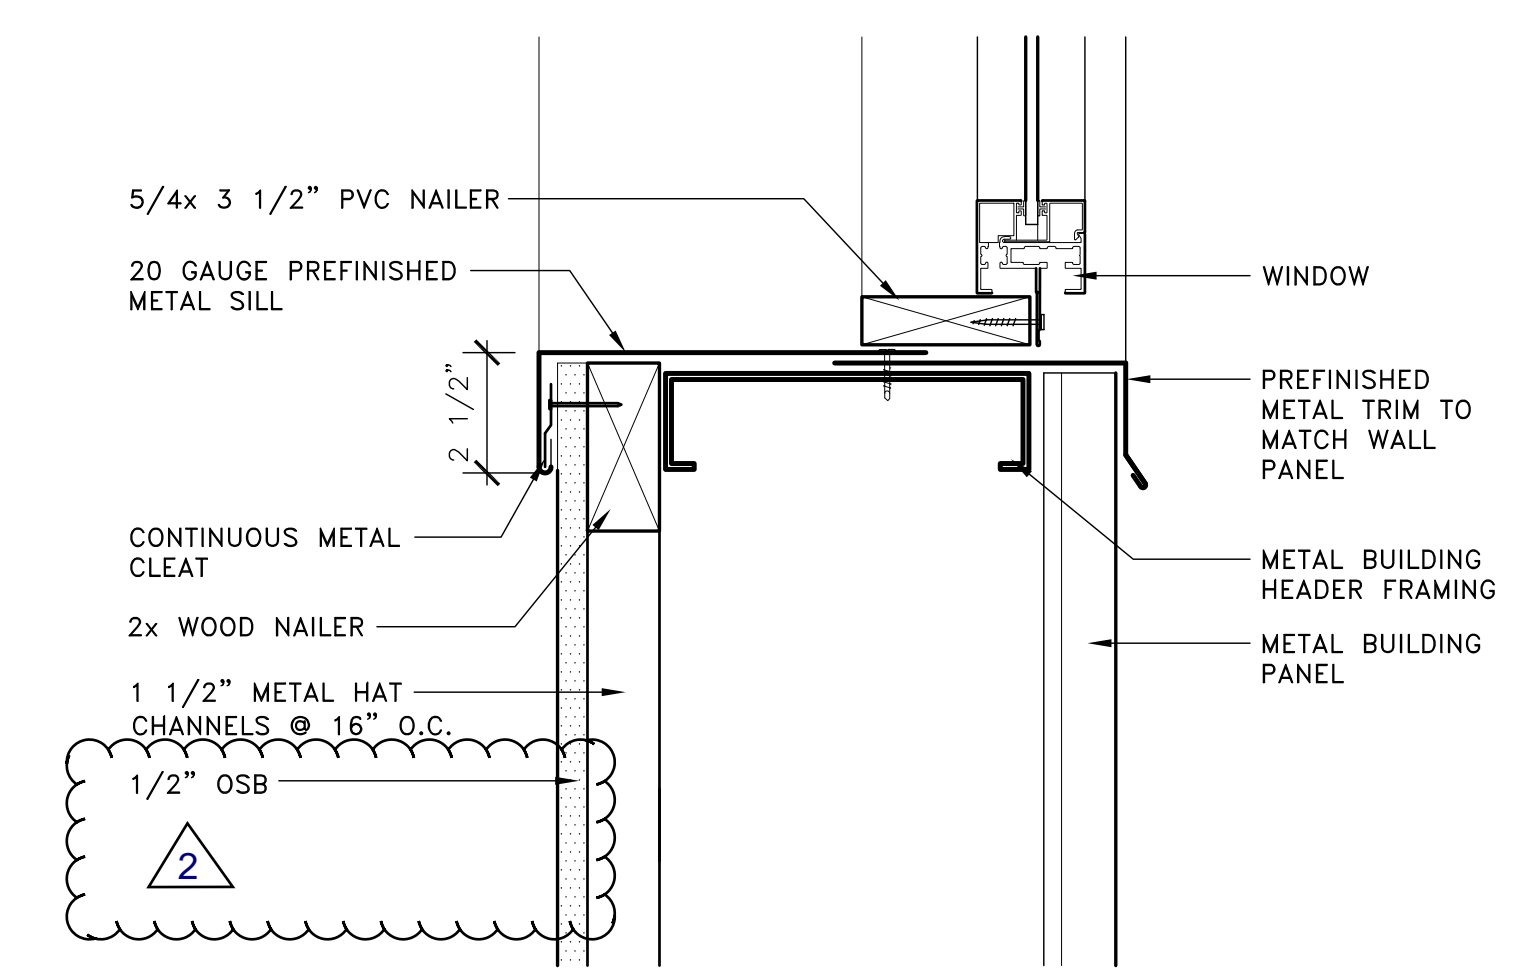

12 WINDOW SILL
 3" = 1'-0"

ABBREVIATIONS	
AC	AIR CONDITIONING
AFCI	ARCH FAULT CIRCUIT INTERRUPTER
AMP	AMPS/AMPERAGE
ABV CLG	ABOVE CEILING
AC	ABOVE COUNTER
AFF	ABOVE FINISHED FLOOR
AFC	ABOVE FINISHED GRADE
AIC	AMPERE INTERRUPTING CAPACITY
AL	ALUMINUM
ARCH	ARCHITECT(URAL)
BD	BOARD
BKBD	BACKBOARD
BLDG	BUILDING
C	CONDUIT
CKT	CIRCUIT
CL	CURRENT LIMITING
CLG	CEILING
COND	CONDUCTOR
CB	CIRCUIT BREAKER
CTV	CURRENT TRANSFORMER
CTV	CABLE TELEVISION
CU	COPPER
CWP	COLD WATER PIPE
DB	DIRECT BURIAL
DN	DOWN
DIST	DISTRIBUTION
DPDT	DOUBLE POLE - DOUBLE THROW
DPST	DOUBLE POLE - SINGLE THROW
(E)	EXISTING
EA	EACH
EC	EMPTY CONDUIT
EGC	EQUIPMENT GROUNDING CONDUCTOR
EM	EMERGENCY
EMS	ENERGY MANAGEMENT SYSTEM
EMT	ELECTRICAL METAL TUBING
EPA	EFFECTIVE PROJECTION AREA
EWC	ELECTRIC WATER COOLER
EXT	EXTERIOR
F	FUSE, FUSIBLE
FL	FLOOR
FLA	FULL LOAD AMPERES
FMC	FLEXIBLE METAL CONDUIT
FTL	FEED-THROUGH LUGS
G	GROUNDING ELECTRODE CONDUCTOR, EQUIPMENT GROUNDING CONDUCTOR
GF, GFI, GFCI	GROUND FAULT CURRENT INTERRUPTER
GFP	GROUND FAULT PROTECTION
HP	HORSEPOWER
HVAC	HEATING/VENTILATION/AIR CONDITIONING
IG	ISOLATED GROUND
IMC	INTERMEDIATE METAL CONDUIT
J-BOX, JB	JUNCTION BOX
KCMIL, KCM	KILO CIRCULAR MILS
KVA	KILOVOLTAMPERES
KW	KILOWATT
LCP	LIGHTING CONTROL PANEL
LFMC	LIQUIDTIGHT FLEXIBLE METAL CONDUIT
LGT, LTG	LIGHTING
MAN	MANUFACTURER
MCB	MAIN CIRCUIT BREAKER
MECH	MECHANICAL
MEZZ	MEZZANINE
MLO	MAIN LUGS ONLY
MTD	MOUNTED
MTG HT	MOUNTING HEIGHT
N	NEUTRAL
N-1	NEMA-1
N-3R	NEMA-3R
NA	NOT APPLICABLE
NC	NORMALLY CLOSED
NEC	NATIONAL ELECTRIC CODE
NF	NON-FUSED
NO	NORMALLY OPEN
NTS	NOT TO SCALE
P	POLE
PF	POWER FACTOR
PH OR Ø	PHASE
PNL	PANEL
PT	POTENTIAL TRANSFORMER
PVC	POLYVINYL CHLORIDE
R	RACEWAY
RGS	RIGID GALVANIZED STEEL
RTG	RATING
SCH	SCHEDULE
SFB	SUB-FEED BREAKER
SN	SOLID NEUTRAL
SPD	SURGE PROTECTIVE DEVICE
SPDT	SINGLE POLE - DOUBLE THROW
SPST	SINGLE POLE - SINGLE THROW
SS	SPECIAL SYSTEMS
SW	SWITCH
SWBD	SWITCHBOARD
TEL	TELEPHONE
TV	TELEVISION
TYP	TYPICAL
UG	UNDERGROUND
UNO	UNLESS NOTED OTHERWISE
V	VOLTAGE/VOLTS
VA	VOLT-AMPERE
W	WIRE
W/	WITH
WP	WEATHER-PROTECTED
XFMR	TRANSFORMER


ELECTRICAL SYMBOL SCHEDULE	
SYMBOL	DESCRIPTION
	LUMINAIRE - SURFACE MOUNTED OR SUSPENDED
	LUMINAIRE - RECESSED IN CEILING
	LUMINAIRE - WALL OR BRACKET
	LUMINAIRE - RECESSED IN CEILING, SURFACE MOUNTED, OR SUSPENDED
	LUMINAIRE - EMERGENCY
	EXIT LIGHT CEILING MTD. ARROWS AS NOTED. SHADING DENOTES SIDE WITH FACE.
	EXIT LIGHT WALL MTD. ARROWS AS NOTED. SHADING DENOTES SIDE WITH FACE.
	EMERGENCY BATTERY LIGHTING UNIT WITH TWIN HEADS.
	EMERGENCY BATTERY LIGHTING UNIT WITH TWIN HEADS AND EXIT SIGN.
	"X" DENOTES LUMINAIRE TYPE PER SCHEDULE; "o" DENOTES SWITCH CONTROL (TYP. FOR ALL LUMINAIRES). NUMBER INDICATES BRANCH CIRCUIT. PROVIDE WIRING AS NECESSARY.
	SWITCH WITH OCCUPANCY SENSOR, WALL MOUNT AT 48" UNLESS NOTED.
	TOGGLE SWITCH WITH 0-10V DIMMING CAPABILITY AT 48" UNLESS NOTED.
	DIMMER SWITCH AT 48" UNLESS NOTED. DIMMER SHALL BE COMPATIBLE WITH FIXTURE(S) CONTROLLED.
	TOGGLE SWITCH, DOUBLE POLE - SINGLE THROW.
	TOGGLE SWITCH, THREE-WAY AT 48" UNLESS NOTED.
	TOGGLE SWITCH, FOUR-WAY AT 48" UNLESS NOTED.
	MOTOR RATED TOGGLE SWITCH WITH THERMAL OVERLOAD ELEMENT
	TOGGLE SWITCH, KEY OPERATOR AT 48" UNLESS NOTED.
	TOGGLE SWITCH WITH DIGITAL TIMER AT 48" UNLESS NOTED.
	TOGGLE SWITCH AT 48" UNLESS NOTED, SUBSCRIPT INDICATES DEVICE CONTROLLED.
	OCCUPANCY SENSOR, CEILING MOUNT
	PHOTOELECTRIC CONTROL
	DUPLEX RECEPTACLE (20A, 125V, 3W, GROUNDING TYPE) AT 18" UNLESS NOTED. NUMBER INDICATES BRANCH CIRCUIT. PROVIDE WIRING AS NECESSARY.
	SAME AS BUT WITH INTEGRAL GROUND FAULT CIRCUIT INTERRUPTER
	SAME AS BUT WEATHER PROTECTED WHILE-IN-USE.
	SAME AS BUT CONCEALED BEHIND ELECTRIC WATER COOLER
	QUADRUPEX RECEPTACLE AT 18" UNLESS NOTED. -(2 DUPLEX RECEPT. WITH SINGLE COVER PLATE)
	SPECIALTY RECEPTACLE AT 18" UNLESS NOTED, REFER TO NOTE FOR NEMA DESIGNATION.
	DUPLEX RECEPTACLE FOR TV - REFER TO ELEVATIONS FOR MOUNTING HEIGHT
	PULL BOX
	CONTACTOR
	JUNCTION BOX
	LIGHTING JUNCTION BOX. CONTRACTOR SHALL PROVIDE WIRING AND MAKE CONNECTIONS NECESSARY TO CONNECT EACH FIXTURE IN ROOM AREA.
	DATA OUTLET AT 18" UNLESS NOTED - PROVIDE RECESSED OUTLET BOX W/ 3/4"R STUBBED UP ABOVE ACCESSIBLE CLG.
	DATA OUTLET AT 18" UNLESS NOTED - PROVIDE RECESSED OUTLET BOX WITH QUAD RING AND 1"R STUBBED UP ABOVE ACCESSIBLE CLG.
	AV OUTLET AT MOUNTING HEIGHT PER ELEVATIONS - PROVIDE RECESSED OUTLET BOX WITH QUAD RING AND 1"R STUBBED UP ABOVE ACCESSIBLE CLG.
	ACCESS CONTROL - PROVIDE RECESSED OUTLET BOX W/ 3/4"R STUBBED UP ABOVE ACCESSIBLE CLG.
	DOOR CONTACT - PROVIDE RECESSED OUTLET BOX W/ 3/4"R STUBBED UP ABOVE ACCESSIBLE CLG.
	CAMERA - PROVIDE RECESSED OUTLET BOX W/ 1"R STUBBED UP ABOVE ACCESSIBLE CLG.
	PANELBOARD/DISTRIBUTION BOARD SURFACE MOUNTED OR RECESSED IN WALL
	TRANSFORMER
	POWER METER
	CURRENT TRANSFORMER
	DISCONNECT OR SAFETY SWITCH
	6-BUTTON LIGHTING CONTROL STATION AT 48" UNLESS NOTED.
	MOTOR
	NUMBER OF TICK MARKS INDICATES NUMBER OF CURRENT CARRYING CONDUCTORS (NOT INCLUDING EGC)
	RACEWAY TURN DOWN
	RACEWAY TURN UP
	RACEWAY-HOMERUN CIRCUIT "2" TO PANEL "HB1" (ARROWS DENOTE CIRCUITS)
	RACEWAY ROUTED CONCEALED OVERHEAD OR IN WALLS
	RACEWAY ROUTED EXPOSED
	RACEWAY ROUTED IN OR UNDER FLOOR SLAB OR UNDERGROUND
	CIRCUIT CONTINUATION.
	CALL OUT TAG (NUMBER OF PLAN REFERENCED ON TOP AND NUMBER OF SHEET REFERENCED ON BOTTOM)
	ELEVATION CALL OUT TAG (NUMBER OF PLAN REFERENCED ON LEFT AND NUMBER OF SHEET REFERENCED ON RIGHT)
	REVISION NUMBER
	DENOTES 30A SAFETY SWITCH/15A FUSE(S)/3 POLES, 4 WIRE/250V RATED/NEMA-3R RATED ENCLOSURE.
	NEAR ANY ELECTRICAL DEVICE DENOTES ABOVE COUNTER TOP.
	NEAR ANY ELECTRICAL DEVICE DENOTES BELOW COUNTER TOP.
	NEAR ANY ELECTRICAL DEVICE DENOTES WEATHER-PROTECTED.
	NEAR ANY ELECTRICAL DEVICE DENOTES CEILING MOUNTED.
	NEAR ANY ELECTRICAL DEVICE DENOTES WALL MOUNTING HEIGHT. MOUNTING HEIGHT IS TO BE CENTERLINE OF DEVICE ABOVE FINISH FLOOR OR GRADE.

SHEET INDEX		
SHEET NO.	SHEET TITLE	ISSUE
E0.0	SCHEDULES AND ABBREVIATIONS	● ●
E0.1	RISER AND SCHEDULES	● ●
E0.2	GENERAL ELECTRICAL NOTES	●
E1.0	ELECTRICAL SITE	●
E2.0	CLASSROOM LIGHTING	●
E3.0	CLASSROOM POWER & SS	● ●
E3.1	SIMULATOR ELECTRICAL	●



An Architectural Corporation
 1111 South Foster Drive
 Suite D
 Baton Rouge, LA, 70806
 T (225) 761-5191
 bbilusa.com

REVISIONS:
 11/01/24 ADDENDUM 2

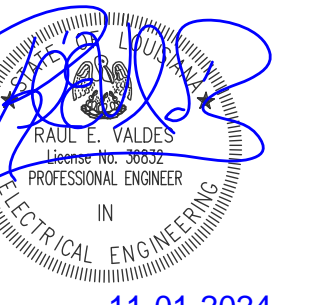

11-01-2024


BATON ROUGE POLICE DEPARTMENT
 TRAINING FACILITY
 999 WEST IRENE ROAD, ZACHARY, LA 70791

SHEET TITLE
 SCHEDULES
 AND
 ABBREVIATIONS

Job No. : A24-005
 Date : 10/1/2024
 Drawn By : DAE
 Checked By: RV

SHEET

E0.0

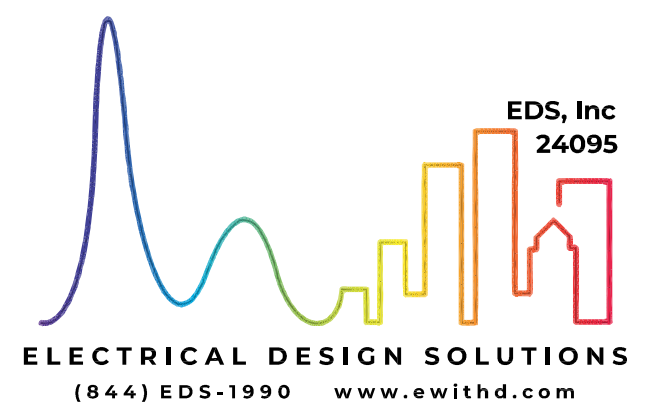

© 2024 bbi ARCHITECTS, AN ARCHITECTURAL CORPORATION

LUMINAIRE SCHEDULE (FINISH COLORS TO BE DETERMINED BY ARCHITECT)

LABEL	MANUFACTURER	CATALOG NUMBER	MOUNTING	NOMINAL LUMEN OUTPUT	NOMINAL CCT	CRI	INPUT VOLTS / WATTS	DESCRIPTION
F1A	METALUX	22GR-LD5-32-F1-UNV-L835-CD1 / DF-22W-U	RECESSED	>=3100	3500K	>=80	120V / <=25W	2' X 2', LENSED, LED TROFFER WITH DRYWALL FRAME KIT.
	LITHONIA LIGHTING	2GTL-F-2-33L-GZ10-LP835 / DGA22						
	TRACE-LITE	CBLS-22-CP / LP22-FMK						
F1B	METALUX	22GR-LD5-40-F1-UNV-L835-CD1	RECESSED	>=4100	3500K	>=80	120V / <=33W	2' X 2', LENSED, LED TROFFER WITH 0-10V DIMMER DRIVER.
	LITHONIA LIGHTING	2GTL-F-2-40L-GZ10-LP835						
	TRACE-LITE	CBLS-22-CP						
F2	METALUX	UHBS-1218-MV-L84050	PENDANT ⊙ 17'-8" AFF UNO	>=13000	4000K	>=80	120V / <=82W	13" DIAMETER, ROUND LED HIGH BAY WITH SELECTABLE CCT AND LUMEN; WET LOCATION LISTED.
	LITHONIA LIGHTING	REBL-ALO13-MD-UVOLT-SWW9-80CRI-**-M2						
	TRACE-LITE	RSHL-100-CP-**-**						
F2E	METALUX	UHBS-1218-MV-L84050 / EBP-RM40R	PENDANT ⊙ 17'-8" AFF UNO	>=13000	4000K	>=80	120V / <=82W	13" DIAMETER, ROUND LED HIGH BAY WITH SELECTABLE CCT AND LUMEN, WET LOCATION LISTED AND 40W EMERGENCY DRIVER.
	LITHONIA LIGHTING	REBL-ALO13-MD-UVOLT-SWW9-80CRI-**-M2 / RBAY-BLDE40WCP-M4						
	TRACE-LITE	RSHL-100-CP-**-BB						
F3	METALUX	TLED112P-42-VS-4K	WALL ⊙ 12'-0" AFF UNO	>=2000	4000K	>=80	120V / <=27W	LED WALL PACK; WET LOCATION LISTED.
	LITHONIA LIGHTING	ARC1-LED-P2-40K-MVOLT-**-**						
	INVUE	CCW-VA1-840-U-T1-**-**						
F3E	METALUX	TLED112P-42-VS-4K-BB	WALL ⊙ 12'-0" AFF UNO	>=2000	4000K	>=80	120V / <=27W	LED WALL PACK WITH INTEGRAL EMERGENCY BATTERY PACK; WET LOCATION LISTED.
	LITHONIA LIGHTING	ARC1-LED-P2-40K-MVOLT-E4WH						
	INVUE	CCW-VA1-840-U-T1-**-EBP						
X1	SURE-LITES	LPXC25	PER PLANS	-	-	-	120V / <=5W	SELF-POWERED, POLYCARBONATE, LED COMBINATION EXIT SIGN-EMERGENCY LUMINAIRE WITH NICKEL CADMIUM BATTERY, WHITE BACKGROUND, RED LETTERS, DUAL ADJUSTABLE HEADS, AND MINIMUM 25'-0" LIGHT THROW. PROVIDE FACES AND ARROWS AS PER PLANS.
	LITHONIA LIGHTING	LHQM-LED-R-M6						
	EXITRONIX	QCRT-R						
Y1	SURE-LITES	APEL	WALL ⊙ 7'-6" AFF UNO	-	-	-	120V / <=5W	THERMOPLASTIC, SELF-POWERED, LED EMERGENCY LUMINAIRE WITH NICKEL CADMIUM BATTERY, AND DUAL ADJUSTABLE HEADS.
	LITHONIA LIGHTING	EUZL-M12						
	EXITRONIX	QMR						

PANEL NAME: PANEL A		MAINS RATING: 250A		VOLTAGE RATING: 240/120				
MOUNTING:	SURFACE	PH BUS MATERIAL:	CU / AL	ENCLOSURE TYPE:	N-3R			
MAINS TYPE:	MLO	G BUS MATERIAL:	CU	AIC RATING:	10,000			
		SUBFEED:		NONE				
#	CB TRIP RTG (A)	P	LOAD				#	
			DESCRIPTION	PHASE A VA	PHASE B VA	DESCRIPTION		
1	20	1	REC - CLASSRM	720	825	1	20	2
3	20	1	REC - CLASSRM	900	281	1	20	4
5	20	1	REC - RR	360	8328	1	20	6
7	20	1	REC - EXTERIOR	720	8328	1	20	8
9	20	1	REC - STORAGE	900	8328	1	20	10
11	20	1	FAN 1	696	3120	1	20	12
13	20	1	FAN 2	500	3120	1	20	14
15	20	1	REC - IT	500	3120	1	20	16
17	20	1	REC - IT	500	3120	1	20	18
19	45	2	IWH-2	4150	2050	2	30	20
21	20	1	FLOODSAFE KIT	600	2050	1	25	22
23	20	1	SPACE	2050		1	25	24
25	20	1	SPACE			1	25	26
27	20	1	SPACE			1	25	28
29	20	1	SPACE			1	25	30
TOTAL CONNECTED VA				35147	34843	PANEL GENERAL NOTES:		
TOTAL CONNECTED A				336				
TOTAL DIVERSIFIED VA				48487				
TOTAL DIVERSIFIED A				233				
CIRCUIT NOTES								
(1)								
(2)								
(3)								
(4)								

PANEL NAME: PANEL B		MAINS RATING: 100A		VOLTAGE RATING: 240/120				
MOUNTING:	SURFACE	PH BUS MATERIAL:	CU / AL	ENCLOSURE TYPE:	N-3R			
MAINS TYPE:	MCB	G BUS MATERIAL:	CU	AIC RATING:	10,000			
		SUBFEED:		NONE				
#	CB TRIP RTG (A)	P	LOAD				#	
			DESCRIPTION	PHASE A VA	PHASE B VA	DESCRIPTION		
1	20	1	REC - CAT WALK (1)	720	1352	1	20	2
3	20	1	REC - CAT WALK (1)	720	758	1	20	4
5	20	1	FAN 1	696	135	1	20	6
7	20	1	FAN 2	696	162	1	20	8
9	20	1	FAN 3	1000	0	1	20	10
11	20	1	EWC	1000		1	20	12
13	20	1	EF-1	40		1	20	14
15	20	1	SPACE			1	20	16
17	20	1	SPACE			1	20	18
19	20	1	SPACE			1	20	20
21	20	1	SPACE			1	20	22
23	20	1	SPACE			1	20	24
TOTAL CONNECTED VA				3943	3336	PANEL GENERAL NOTES:		
TOTAL CONNECTED A				35				
TOTAL DIVERSIFIED VA				7177				
TOTAL DIVERSIFIED A				35				
CIRCUIT NOTES								
(1) PROVIDE GFCI CIRCUIT BREAKER.								
(2)								
(3)								
(4)								

GENERAL NOTES:



- PROVIDE PULL BOXES AS PER MANUFACTURER'S RECOMMENDATIONS TO MEET MANUFACTURER REQUIREMENTS FOR MAXIMUM PULL LENGTHS.

SPECIFIC NOTES:

- MAIN SERVICE GROUND. PROVIDE COPPER GROUND, SIZED AS SHOWN, PER NEC 250.52.
- 100A/100AF/2P,3W/240V/N-3R SERVICE RATED DISCONNECT SWITCH. FUSES SHALL BE BUSSMANN LPN-RK-100SP.
- PROVIDE NEUTRAL TO GROUND BONDING PER NEC 250.
- COORDINATE WITH UTILITY TO PROVIDE RACEWAY AND/OR WIRING PER THEIR REQUIREMENTS.
- PROVIDE GROUNDING, SIZED AS SHOWN, FOR A STRUCTURE BEING SUPPLIED BY A FEEDER FROM A SEPARATE STRUCTURE PER NEC 250.32.
- 400A/250AF/2P,3W/240V/N-3R SERVICE RATED DISCONNECT SWITCH. FUSES SHALL BE BUSSMANN LPN-RK-250SP.


FEEDERS

- 2 SETS OF [3 #3/0 & 1 #1/0(G) IN 2"R.]
- 3 #1 & 1 #1/0(G) IN 1-1/2"R.
- 3 #1 & 1 #8(G) IN 1-1/2"R.
- 3 #250MCM & 1 #4(G) IN 2-1/2"R.

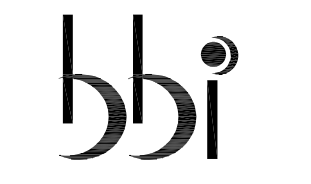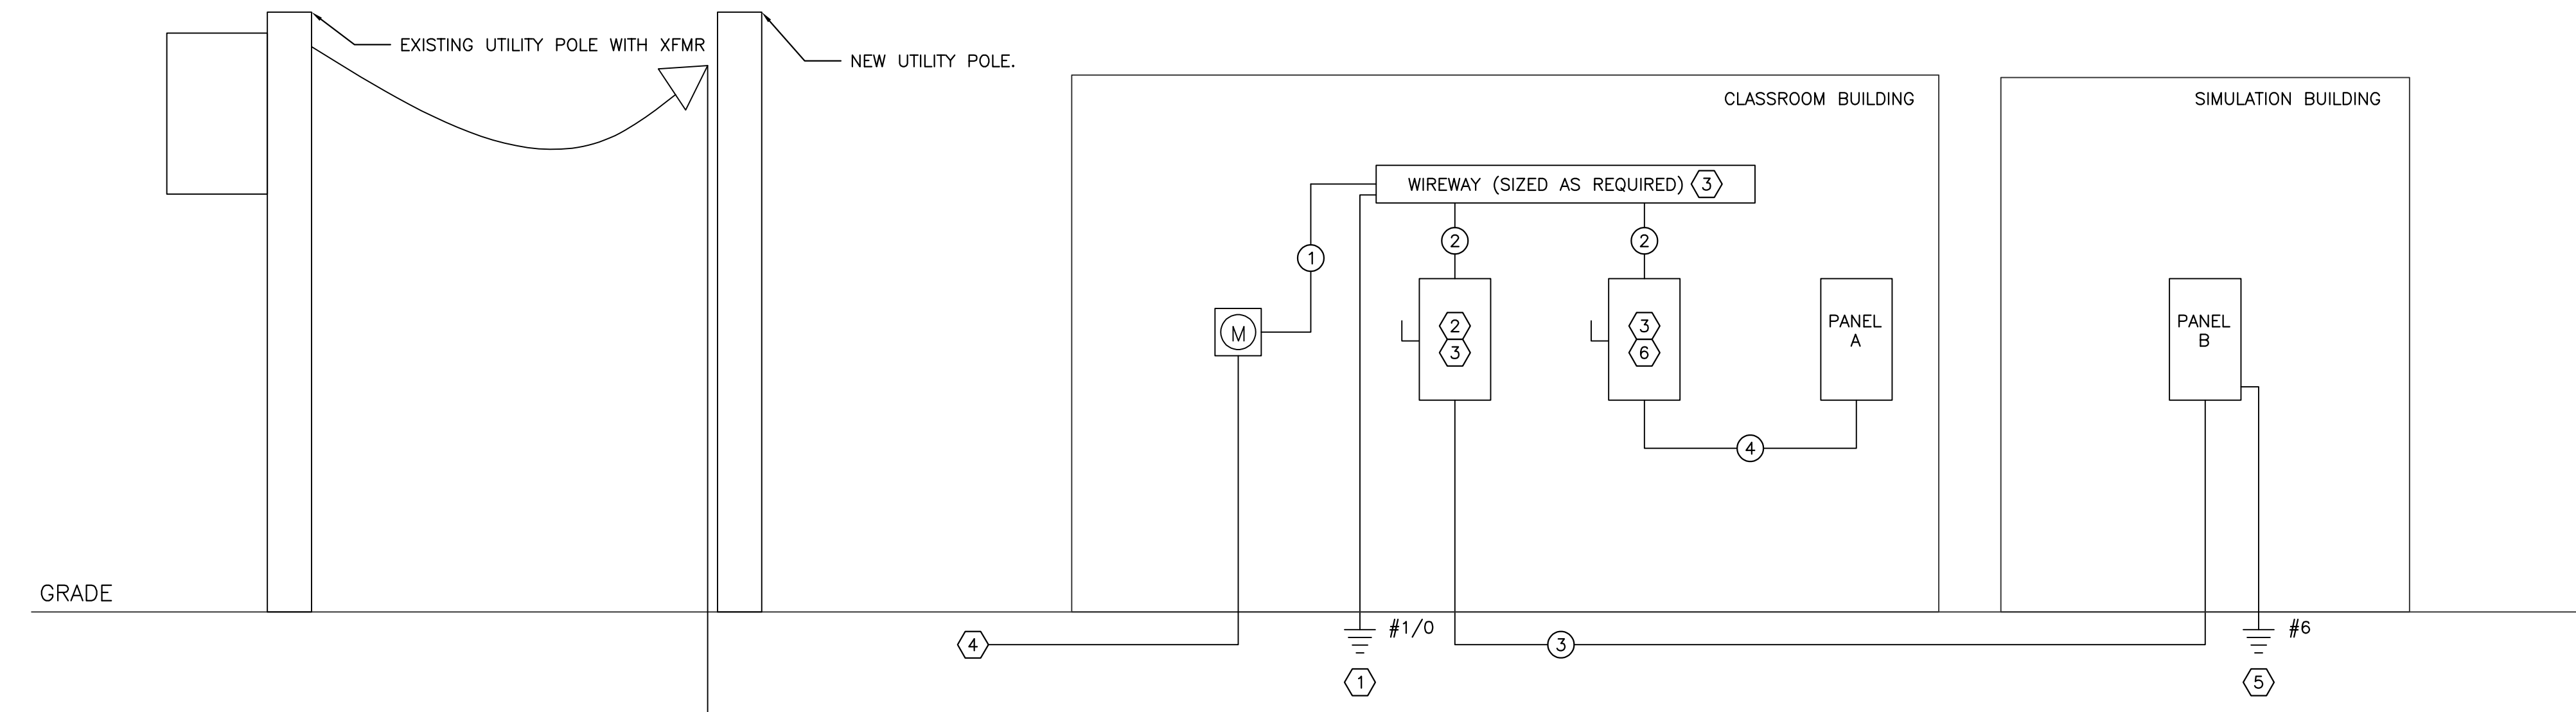

An Architectural Corporation
1111 South Foster Drive
Suite D
Baton Rouge, LA, 70806
T (225) 761-5191
bbiusa.com

REVISIONS:
11/01/24 ADDENDUM 2

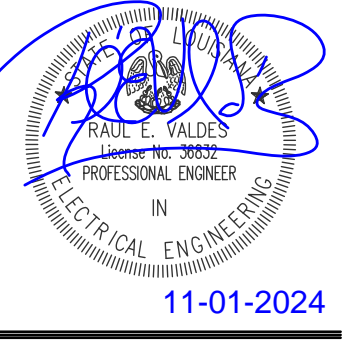

**BATON ROUGE POLICE DEPARTMENT
TRAINING FACILITY**
 999 WEST IRENE ROAD, ZACHARY, LA 70791


SHEET TITLE

RISER AND SCHEDULES

Job No. : A24-005
Date : 10/1/2024
Drawn By : DAE
Checked By: RV

SHEET

E0.1

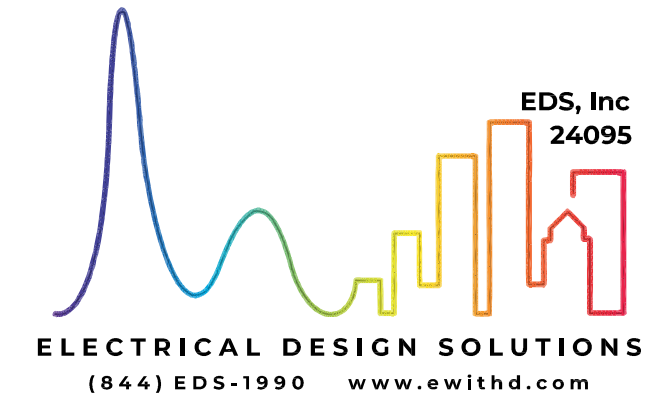

© 2024 bbi ARCHITECTS, AN ARCHITECTURAL CORPORATION

